



Switched-on to Resilience

**ASSET MANAGEMENT
PLAN 2024 UPDATE**
FOR THE PERIOD
1ST APRIL 2024
THROUGH TO
31ST MARCH 2034



Table of Contents

Ngā Rārangi Take

Executive summary 2

1 2 3 4 5 6

Background 4	Investing in our network 10	Asset management plan update 26	Schedules 42	Tranche 1 amended information requirements 70	Directors' certificate 94
------------------------	---------------------------------------	---	------------------------	---	-------------------------------------

1.1 Growing the Waikato 6	2.1 Electrification 12	3.1 A quick overview. 28	4.1 Schedule 11a: Report on forecast capital expenditure 44	5.1 Amendment Q1 72
1.2 Our purpose, vision, and strategy. 7	2.2 What resilience means to us. 12	3.1.1 What material changes are there to our inflation forecast? 28	Schedule 11b: Report on forecast operational expenditure 56	5.2 Amendment Q2 73
1.3 Get to know our network 8	2.2.1 Network specific climate change resilience improvement actions 15	3.1.2 What material changes are there to underlying growth factors? 28	4.2 Schedule 12a: Report on asset condition 60	5.3 Amendment Q3 77
1.3.1 Why have we updated our AMP? 8	2.3 Future focused: our digital journey 17	3.2 What material changes are there to forecast capital expenditure? 30	4.3 Schedule 12b: Report on forecast capacity 64	5.4 Amendment Q4 80
1.3.2 What's the purpose of this AMP? 8	2.4 From good to great: our Distributed System Operator (DSO) initiatives 20	3.2.1 Customer Initiated Works (CIW) 30	4.4 Schedule 12c: Report on forecast network demand 66	5.5 Amendment Q5 82
1.3.3 What's the duration of our new plan? 8	2.5 Distributed Energy Resources (DER) 23	3.2.2 Network development 31	4.5 Schedule 12d: Report forecast interruptions and duration 68	5.6 Amendment Q13 83
1.3.4 What is the certificate date? 8		3.2.3 Asset replacement and renewal. 34	4.6 Schedule 14a: Mandatory Explanatory Notes on Forecast Information 69	5.7 Amendment D2 84
1.3.5 Who is the plan intended for? 8		3.2.4 Non-network CAPEX 36		5.8 Amendment D4 86
1.3.6 What areas does the information disclosure cover? 8		3.3 What material changes are there to forecast operational expenditure? 37		5.9 Amendment AM7A/AM7B 88
1.4 Why forecasting matters. 9		3.3.1 Network OPEX 37		5.10 Amendment AM8A/AM8B 90
1.4.1 What can we do to mitigate change? 9		3.3.2 OPEX - non-network 38		
1.4.2 Can you expect to see any more changes? 9		3.4 What material changes are there to forecast total capital expenditure? 39		
		3.4.1 Total CAPEX 39		
		3.5 What material changes are there to forecast total operational expenditure? 40		
		3.6 Material changes to asset management practice 41		
		3.7 Material changes to planned network outages 41		

Powering progress

We're more excited about our future than ever before. To find out more about the journey ahead, our 2024 Asset Management Plan update (AMP update) highlights the material changes in key investments for the next ten years. This not only involves maintaining the high-quality network we're known for, but also planning for future demand by continually innovating. All up, it means we're keeping our customers and stakeholders at the forefront of our decision making.

The electricity sector is not immune to uncertainty and many factors can affect forecasting demand, from emerging new technologies to evolving policy and changing markets. On the supply side, global conflicts continue to destabilise trade and supply chains, and inflation has continued to increase the cost of delivering work. Despite these shifts, we're still determined to make long-term investment decisions that will have a net cost-benefit for our customers and ensure that our network remains safe, resilient, reliable, sustainable, and affordable.

Seeing the road ahead

Our E³ Strategy (see p.7) provides the framework for how we will navigate these challenges. You'll see it focuses on extracting more value from the core business, exploring alternative energy solutions, and expanding our capabilities well into the future. This AMP Update builds on the progress made during 2023 and should be read in conjunction with last year's full AMP.

During the planning period of this AMP Update, we remained focused on collecting more data on our exposure to natural disasters to allow detailed planning for risk reduction in future years. Cyclones Dovi and Gabrielle provided first-hand experience of the intensity of storms we may expect in the future. We have also commissioned resilience exposure studies that are assisting us to develop targeted and prioritised initiatives.

Structures to support our approach

In addition to the development of our core business systems and capabilities outlined in this document, our asset management system is currently being aligned to the requirements of the ISO 55001 Asset Management Standard.

Safety remains a priority, and we continue to apply a "Good Work" approach which is captured in an internal three-year continuous improvement plan.

Phase 1 of our Distribution System Operator (DSO) transformation roadmap is underway and is providing enhanced visibility of our high and low voltage networks. Section 2 provides detail around this, and any necessary investments are clearly outlined in this document.

Powering up potential

October 2023 saw the launch of our 35MWh Rotohiko Battery Energy Storage System (BESS), the first battery of this scale in New Zealand. It's an exciting milestone for our business which improves the resilience of the electricity system and will increase the value of intermittent renewable generation in the region as uptake accelerates. Our investment in network technology – as well as our support for EV uptake through We.EV – demonstrates our ongoing commitment to a brighter, more sustainable energy future.

AT A GLANCE : IN OUR 2024 AMP UPDATE, THE MOST SIGNIFICANT CHANGES OVER THE PERIOD OF THE 2023 AMP ARE:

AN INCREASE IN OUR CUSTOMER INITIATED WORKS FORECAST OF

\$95.1M

Although we're expecting a slowdown in residential, commercial, and industrial development activity in FY25, growth is not expected to be as slow as previously forecast. Increased demand is expected from the middle of the planning period. This demand is expected to rise from; residential intensification of Hamilton, increased investment in decarbonisation of industrial processes, growing EV uptake, and increasing adoption of distributed generation and distributed energy resources.

AN UPLIFT OF

\$3.3M

FOR ASSET REPLACEMENT AND RENEWAL

Over the past 12-months we've identified opportunities to improve the forecasting of the required asset replacement programme, via upfront scoping of all asset classes and improved per unit cost estimation. However we will still have a small uplift of \$3.3M due to changes in asset replacement quantities, as detailed in section 3.2.3. These adjustments will ensure that our investments are not only prudent and efficient, but will also deliver a network that remains safe, resilient, and reliable – ultimately enabling our communities to thrive.

AN UPLIFTED INVESTMENT IN NON-NETWORK CAPEX BY

\$23.5M

This will support the significant enhancement of our asset management and DSO capabilities and covers LV works management, digital transformation, data management, acquisition, and platform services.

AN UPLIFT OF

\$13.5M

FOR NETWORK OPEX

The past year has seen continued increases in our Network OPEX costs. These have been driven by increases in labour costs and service provider costs (e.g. traffic management). We expect that these costs will continue to increase in line with inflation so have factored this in to the projected OPEX spend.

AN INCREASE OF

\$6.4M

FOR NETWORK DEVELOPMENT

The bulk of this is to improve the resilience of the network from high impact, low probability (HILP) events and bring forward feeder reliability projects to enhance our network performance.


AN UPLIFT OF

\$43.8M

FOR NON-NETWORK OPEX

In FY25 we are planning to upgrade SAP to S/4Hana and invest in integration and data platforms (adding \$4M). In addition, our digital transformation is estimated to add \$4M pa in SaaS/licencing costs.

CHAPTER 1
BACKGROUND
KUPU WHAKATAKI

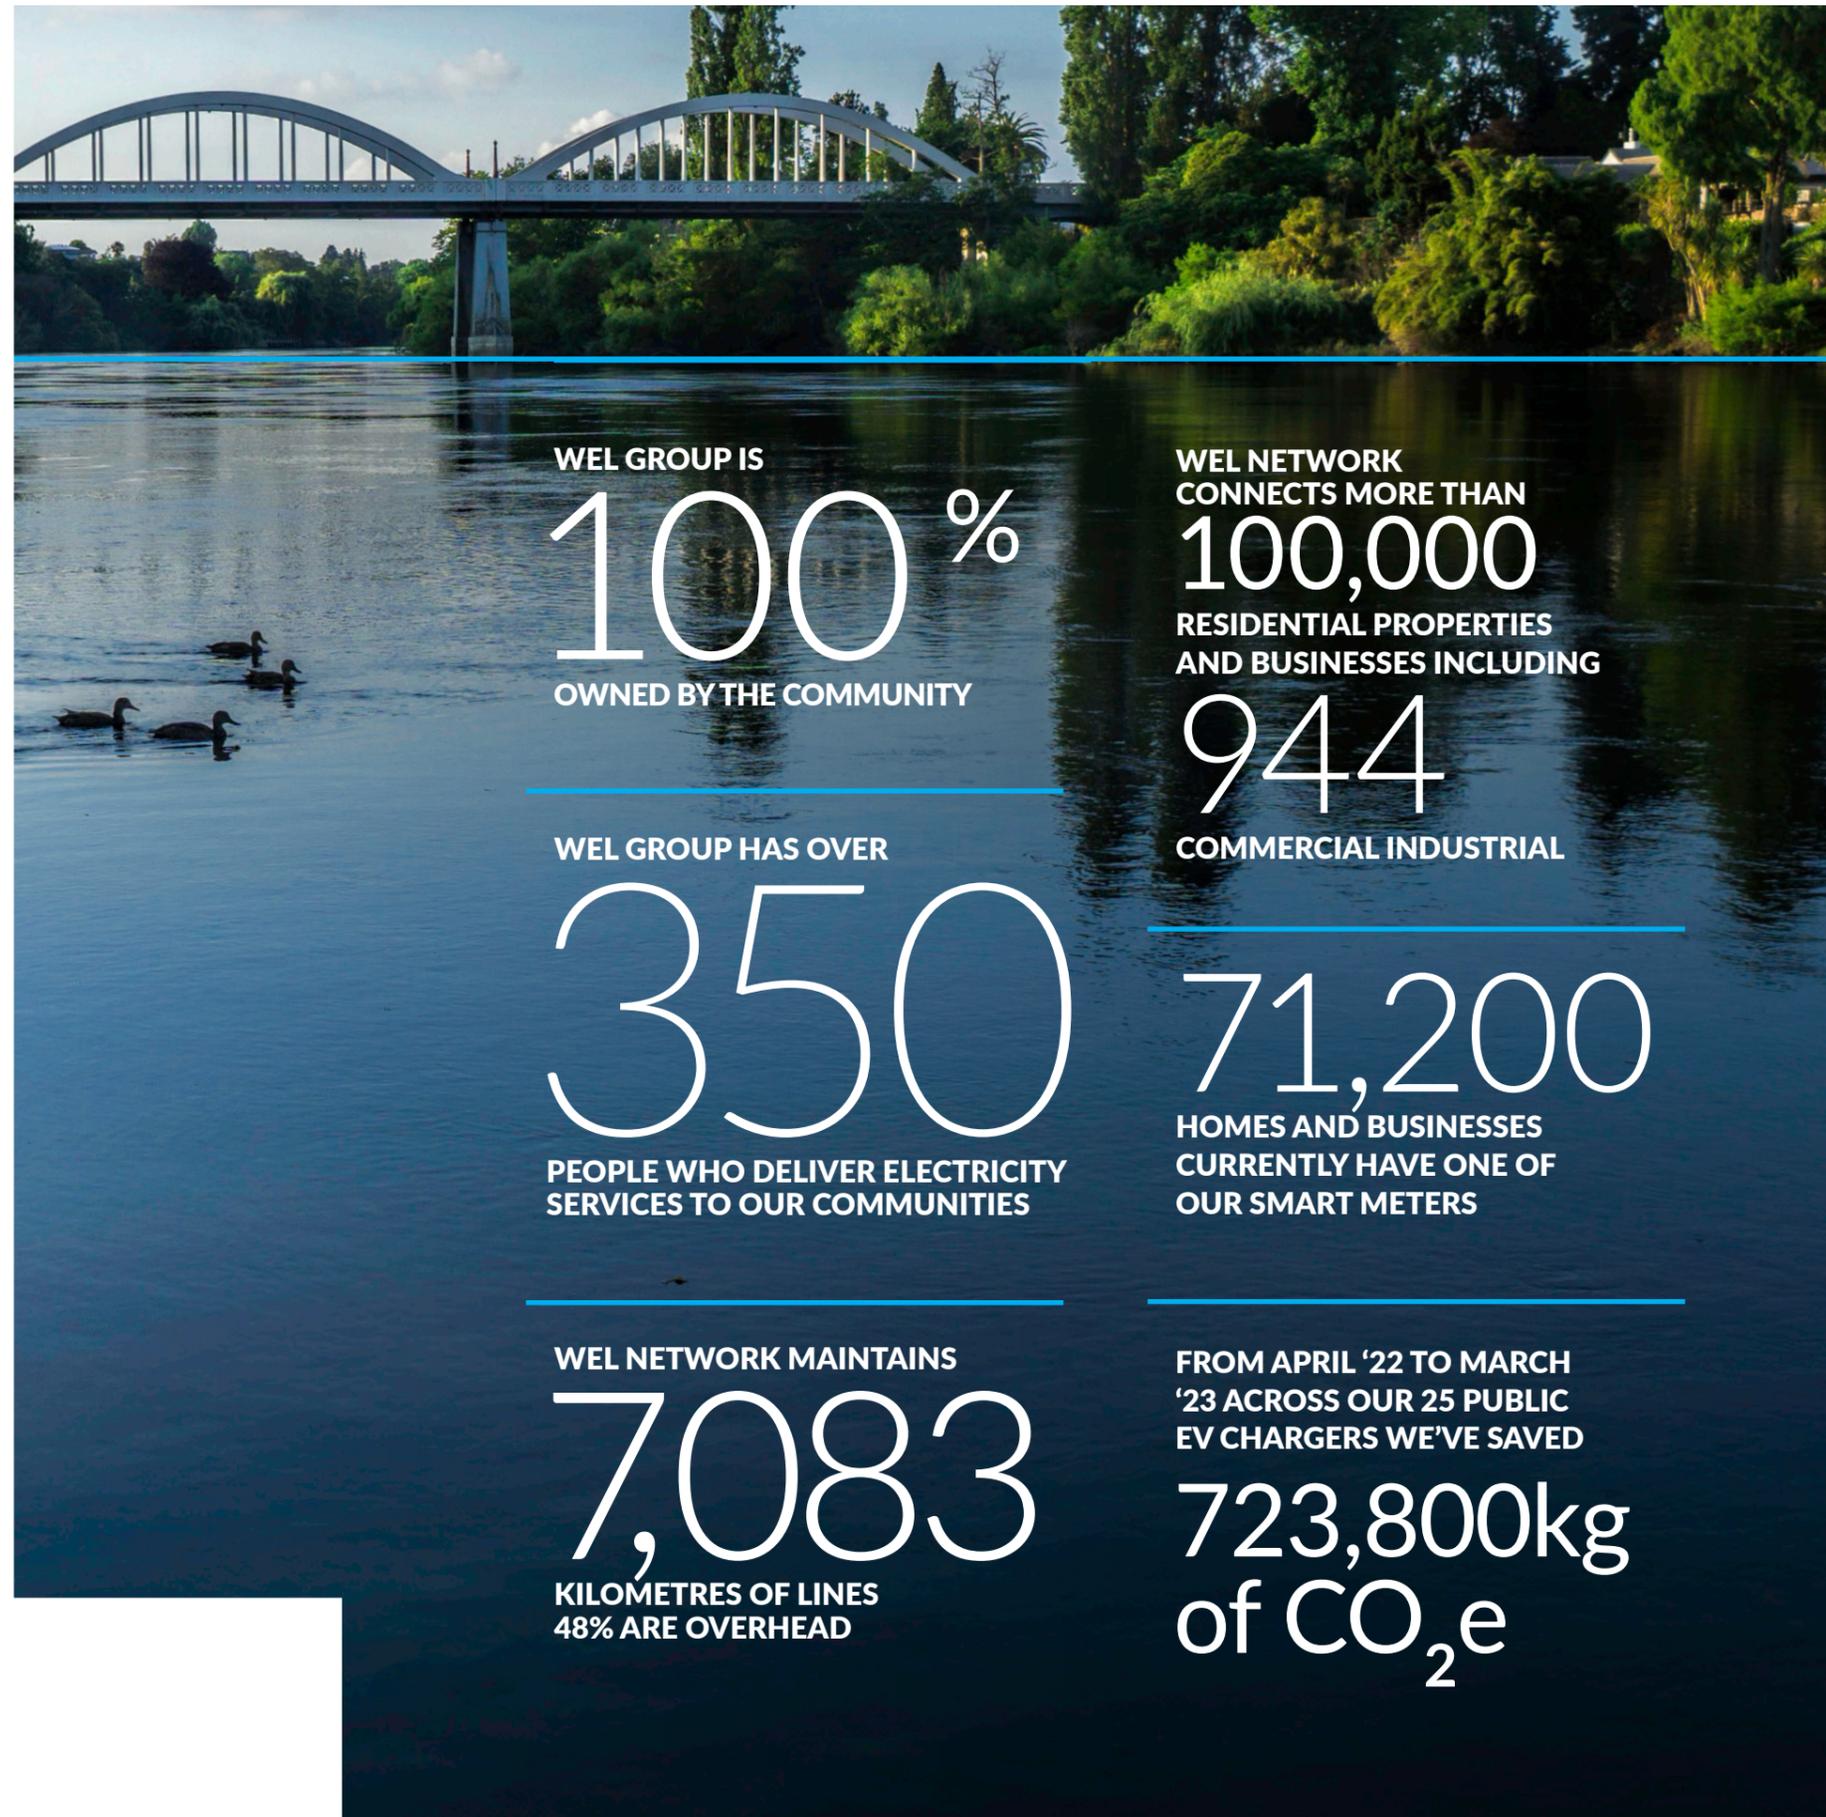

WEL GROUP IS
100%
OWNED BY THE COMMUNITY

WEL NETWORK
CONNECTS MORE THAN
100,000
RESIDENTIAL PROPERTIES
AND BUSINESSES INCLUDING
944
COMMERCIAL INDUSTRIAL

WEL GROUP HAS OVER
350
PEOPLE WHO DELIVER ELECTRICITY
SERVICES TO OUR COMMUNITIES

71,200
HOMES AND BUSINESSES
CURRENTLY HAVE ONE OF
OUR SMART METERS

WEL NETWORK MAINTAINS
7,083
KILOMETRES OF LINES
48% ARE OVERHEAD

FROM APRIL '22 TO MARCH
'23 ACROSS OUR 25 PUBLIC
EV CHARGERS WE'VE SAVED
723,800kg
of CO₂e

1 About us

1.1 GROWING THE WAIKATO

WEL's network stretches from Hamilton in the southeast, to Raglan in the west and to Maramarua in the north. WEL also owns and operates small, embedded networks in Cambridge and the Auckland Region.

Our electricity network consists of six main elements: Grid Exit Points, Distributed Generation, 33kV Subtransmission, Zone Substations, 11kV Distribution and the Low Voltage Network.



FIGURE 1
WEL Networks boundary and small embedded networks in Cambridge and Auckland

1.2

OUR PURPOSE

Enabling our communities to thrive

OUR VISION

To create and support an innovative and sustainable energy future



We deliver that through our

STRATEGY

A strategy that unlocks our energy potential by extracting value from our core services, exploring energy solutions, and expanding our thinking into the future.

EXTRACT

THE CORE VALUE

ENSURING WE GAIN THE GREATEST BENEFIT FROM THE INVESTMENTS MADE IN OUR CORE INFRASTRUCTURE.

EXPLORE

ENERGY SOLUTIONS

PROVIDING WHAT CUSTOMERS AND BUSINESSES NEED TODAY AND TOMORROW FOR A LOW CARBON, LOW PRICE, CHOICE-DRIVEN ENERGY FUTURE.

EXPAND

INTO OUR FUTURE STATE

INCUBATE NEW IDEAS WITH A VIEW TO INVEST IN SCALE-UPS AND START-UPS TO INCREASE OUR OFFERING AND OUR NON-REGULATED REVENUES.

1.3 GET TO KNOW OUR NETWORK

1.3.1 Why have we updated our AMP?

In March 2023 we published a comprehensive Asset Management Plan (2023 AMP), which is available on our website. This AMP Update states material changes (greater than \$500,000) to the 2023 AMP as required by the Electricity Distribution Information Disclosure Determination 2012. We have not repeated the detailed explanations provided in the 2023 AMP here – so it's essential you read the 2023 AMP in conjunction with this update.

Section 1 provides an overview of this AMP, WEL Networks and uncertainty in our planning horizons. It provides our E³ Strategy which has been set to deliver our vision.

Section 2 outlines work that is underway to ensure that WEL adapts to our changing environment and ensures that we are well placed to meet the opportunities ahead.

Section 3 looks at material changes to our current 2023 network development plans, lifecycle asset management plans, and asset management practices – and explains our reasoning behind them.

Section 4 contains our updated Disclosure Schedules.

Section 5 provides a summary of WEL's approach to the Tranche 1 Amended Information Disclosure Requirements.

Section 6 contains the Directors' Certificate.

1.3.2 What's the purpose of this AMP?

This AMP Update has been structured to meet disclosure requirements and is in a similar format to our previous AMP updates. It gives an overview of the changes we foresee in our operating environment – and how these affect our forecasts.

1.3.3 What's the duration of our new plan?

Our AMP period is 1 April 2024 to 31 March 2034, with the caveat that, naturally, there will be a higher level of accuracy in the earlier years than the later ones.

1.3.4 What is the certificate date?

This plan was approved and certified by the WEL Networks Limited Board of Directors on 5th March 2024.

1.3.5 Who is the plan intended for?

The plan is publicly available on our website for anyone to read. However, our primary audiences are our stakeholders, wider community, our customers, the Commerce Commission, the Electricity Authority, and our staff and contractors.

1.3.6 What areas does the information disclosure cover?

This AMP Update covers* material changes in the last AMP to:

- Network development plans
- Lifecycle asset management plans
- Forecast capital and operational expenditure
- Asset management practices of WEL, and
- Drivers underlying those changes.

**Full disclosure requirements are set out in the Electricity Distribution Information Disclosure Determination 2012.*

1.4 WHY FORECASTING MATTERS

Forecasts allow us to plan and help us see any obstacles on the road ahead. But as the past few years have shown, there's always a degree of uncertainty, particularly over longer periods. There are a number of good reasons for this: technology moves quickly, policies change, markets shift, demand fluctuates, and customer trends happen quickly. Other factors, including short-notice commercial customer applications, result in changes in demand that are difficult to predict. On the supply side, there has been significant uncertainty driven by the ongoing economic impact of global conflicts.

1.4.1 What can we do to mitigate change?

The size and timing of our distribution investment is based on net cost-benefit to customers over the lifecycle of customer demand and network assets. It's a tricky balance. Adjusting our network investment ensures that network expansion meets our communities' needs within finite financial and workforce capacity and minimises overall risks.

1.4.2 Can you expect to see any more changes?

Nobody can accurately predict the future, but we can prepare for it based on our best analyses. Consequently, it's possible we will need to make changes as time goes on, in line with our continual improvement philosophy for Asset Management. This means our development plans and corresponding investments may be amended in subsequent revisions of the AMP – reflecting the emerging needs of our customers, stakeholders and changing circumstances on the network.

CHAPTER 2
INVESTING IN OUR NETWORK
HAUMITANGA Ā-WHATUNGA

WE'RE DEALING WITH 6 MACRO MEGATRENDS

1
DIGITAL
TRANSFORMATION
AND DISRUPTIVE
TECHNOLOGIES

2
ENVIRONMENTAL,
SOCIAL AND
GOVERNANCE AND
SUSTAINABILITY

3
CLIMATE CHANGE
MITIGATION AND
ADAPTION

4
LABOUR, SKILLS
SHORTAGE, AND
DEMOGRAPHIC SHIFTS

5
TRADE
AND
GLOBALISATION

6
POLITICAL
AND ECONOMIC
VOLATILITY

LEADING US TO KEY INITIATIVES

- IMPROVING RESILIENCE
- DIGITAL TRANSFORMATION
 - DSO
- ENERGY MANAGEMENT

2 Fast forward

We are investing in the network of the future, so it's fit for purpose today – and tomorrow. From the resilience of our network assets and easier access to information, to the emerging demands of electrification and our Distribution System Operation (DSO) initiatives and changing customer needs, we're focused on building a robust network – and that means greater visibility of LV networks. Here, we describe our response to these drivers.

2.1 ELECTRIFICATION

New Zealand has committed to achieving net zero greenhouse gas emissions by 2050. Electricity has a key role to play in achieving the country's climate ambitions. That said, the changes required – not least the speed at which these changes must be implemented – is unprecedented. Two of the largest impacts are electrification of transport, and electrification of heating systems (process heat in particular).

Electric Vehicles (EV) are here to stay

We continue to plan for multiple scenarios for EV uptake to guide investment. Our current EV uptake model is based on studies undertaken on the impact of EV on our network from 2021 and updated with real world information from We.EV. As more data comes in, we are starting to see the ramp up of EV charger infrastructure by corporates for both light and heavy vehicles. Currently the EV uptake numbers in the WEL network area are lagging the study by about a year.

EV charging infrastructure is having an impact on both Customer Initiated Works (CIW) and the Network Development CAPEX. This will require investment at all voltage levels, an allowance over the AMP period of \$39M has been allocated under CIW expenditure and \$57M has been made in the Network Development category.

From fossil fuels to cleaner futures

WEL has worked with DETA consultants to gauge the appetite of customers to convert from fossil fuel burning to electricity. While there's little doubt that electrification of commercial business will happen, the timing and extent of that is still largely unknown. There are large variances in the forecasts due to conversion costs and it's expected that biomass boilers will also play a large role in future. Nevertheless, we cannot afford to take a 'wait and see' approach. With this in mind, we have taken a conservative approach to commercial customer electrification and have allowed \$10M over the AMP period. We will continue to monitor this situation and adapt our AMP as we see signs of change in the market and watch as Government and regulatory policy develops.

2.2 WHAT RESILIENCE MEANS TO US

For us, resilience is the capacity to anticipate, absorb, quickly recover, and learn from events that impact on our ability to provide services to our customers.

To ensure we respond effectively to the resilience challenges we have begun to develop a Resilience Strategy which will guide and prioritise our activities. This strategy will be completed in FY25. Our roadmap of activity will be based on the following six macro-Megatrends,

1. Digital transformation and disruptive technologies (including cybersecurity)

Core to transforming our industry over the coming decades will be adoption of new technologies. Technology is seen as a positive disruptor, enabling gains in resource efficiency and productivity. However, technology also comes with an increased risk of cyber-attacks through enhanced connectivity.

Our response:

We're bringing digital and data to the core of our business. Our digital strategy has recently been completed, see section 2.3. We're also increasing our utilisation of leading edge technology and data to ensure that we are placed to provide the network of the future, see also the section on DSO.

2. Environmental, Social and Governance (ESG) and sustainability

Increasingly a business's license to operate hinges on its ESG decisions through adherence to government policies and as more socially conscious generations age there is an expectation that governance and corporate decisions not only consider financials, but also environmental and societal impacts.

Our response:

WEL has an existing Sustainable Business Plan for 2021-30. The plan aligns to four of the of the United Nations' Sustainability Development Goals (SDGs) to focus our activity. This plan will be reassessed in light of the current activity in developing this overarching Resilience Strategy to ensure we address emerging trends and issues. This plan will be updated by the end of FY25.

3. Climate change mitigation and adaption and the low carbon energy transition

We are experiencing more extreme and frequent weather events requiring updated assessments of network resilience with these changing weather patterns. Business's sustainability and ESG decisions as we transition to a low carbon energy system will have significant impact to our industry through electrification. These decisions will increase electricity demand and the need for greater investment in electricity infrastructure.

Our response:

Our strategy to diversify our network assets to include a range of distributed generation is underway with solar farms in progress. Solar farms have the dual benefit of providing redundancy of supply along with being low emission generation.

We achieved a key milestone with the launch of our Rotohiko BESS in October 2023, the largest grid scale battery in NZ. The battery is an energy storage facility which will improve the resilience of the New Zealand electricity system. The battery's role in reducing the need for non-renewable energy sources will be a key contributor to lowering emissions in support of New Zealand's Net Zero emissions target by 2050.

We have commissioned a report on climate related risks to our network, in particular in relation to flooding and inundation. The data is now being factored into network resilience for both new build and remediation. Our next step is to better understand network vulnerabilities in relation to wind (storm) events.

4. Labour, skills shortage, and demographic shifts

The electricity sector is going to experience growth rates higher than ever seen and the demand for people will be significant and globally the sector will be competing for people from the same talent pool. With the digital transformation different skills and capabilities will also be needed to take advantage of new technologies. There are also the changing expectations of younger talent on employers with flexible working and a need for personal alignment to business ethos being an important part of their employment decisions.

Our response:

Our existing workforce plans include growing our own talent through the provision of trainee/ internships and our work on attracting and retaining people. We are completing an external review of our Employee Value Proposition (EVP) to assess our current benefits package and prioritise any additional benefits. Whilst these activities remain a central part of our strategy the volume of work and competition for talent saw us introduce two new network service partners to support our in-house delivery arm with the build and maintenance of our network.

5. Trade and globalisation

Shocks to global trade have prompted responses from companies and governments to increase resilience in their supply chains, and businesses to adapt, creating permanent shifts in global trade patterns and the need to seek more strategic trade partnerships.

Our response:

We are now holding higher stock levels to ensure we keep on top of delays being experienced in the supply chain. Additionally, we have added alternative suppliers across key network stock to provide greater diversification. While the significant delays experienced as a result of Covid have eased we will continue to hold higher stock levels compared with pre-Covid levels due to the ongoing heightened international risks.

6. Political and economic volatility

The scale of change in technology, climate, demographics, and trade will create instability as economies and governments deal with an evolving global environment, with global and domestic risks set to remain or increase over the coming decades. Developed markets will need to increase productivity (in a current environment of productivity recession) against a backdrop of declining working age populations.

Our response:

We are actively involved in both national and international industry groups to ensure we remain up-to-date on the latest trends and any emerging risks. This will help us to proactively respond to anything that arises and helps us to stay at the forefront of industry thinking.

2.2.1 Network specific climate change resilience improvement actions

A review of our response to cyclones Dovi and Gabrielle identified several areas for improvement, including:

- Conversion of a meeting room into a fit-for-purpose incident response room with multiple information screens and all other resources to manage a major event
- Development of a customer restoration prioritisation procedure
- Critical Incident Management System (CIMS) incident management training for key roles involved in our response
- Systems to quickly identify CIMS roles and responsibilities
- Development of smart meter tools to aid in the prioritisation of restoration, verify customer supply post fault restoration, and detect any additional faults (e.g. broken neutrals and loose connections)
- Improved systems for scoping damage and repair methodologies.

Specific improvements included:

1. Mitigating scrub fire risks

We've implemented a system for monitoring and minimising scrub fire risks from network faults, utilising NIWA's Fire Risk modelling data. This system will predict high fire risk conditions to implement control measures and is integrated into our network management system.

2. Locating line clashes

We've used our LiDAR data, fault information and line design software to identify/verify high potential locations of line clashing on the network. We addressed these locations in our FY24 work program.

3. Identifying third party risks

We've undertaken a risk assessment of network assets that are located in third party buildings. This risk assessment is being used to inform our replacement program, refine our inspection/maintenance programmes, and identify mitigations required.



2.3 FUTURE FOCUSED: OUR DIGITAL JOURNEY

From decarbonisation and DER disruption to customer demands and behaviours, the pace of change occurring in our industry is relentlessly fast. The traditional methods of working are neither efficient nor sustainable, so to enable our business we need to have systems and processes that allow our staff and contractors to make effective decisions based on up-to-date data.

Activating our digital strategy

We are currently in the process of a major digital transformation initiative. This will ensure that we have the right digital capabilities in place to support the business and our customers in the years ahead. There are three key areas:

1. Digital electricity network

We need to leverage the vast amounts of data that we capture to make the best possible investment decisions as customer demand increases. Traditional design approaches that are based on assumptions and calculations will be augmented by digital models and actual usage data to optimise our network designs and the resulting capital expenditure. Realtime data from the electricity network will be used to identify operational issues and allow us to substitute reactive fault work for planned maintenance and upgrades.

2. Digital employee experience

This ensures that all business-critical processes are supported with the appropriate digital solutions. In many cases this will mean enabling our staff to leverage data and systems that we already have in the most effective way possible. We'll focus on digitally enabling time-consuming and error prone manual processes to improve efficiency, accuracy, safety and job satisfaction. We'll also provide better support to manage the flow of work through our organisation via digital workflow management and greater enablement of existing mobile devices to provide access to data, documents, and systems when and where they are required. By leveraging modern cloud and mobile technologies, we can deliver an employee experience that both supports and encourages digital collaboration across the whole company, leading to faster, more informed, decision making.

3. Digital Customer experience

We will review our existing customer engagement channels to determine if they are fit for purpose and meeting our customers' expectations. Where we have digitally enabled our internal processes, we will seek to provide transparency of work requests to our customers to enable customer self-service via updated and/or new digital channels. We will seek new ways to become closer to our customers and to better understand their needs and support them through greater use of digital technology.

Platforms in progress

Underpinning this work will be several foundational platforms. While some of these platforms are already in place, there is still a significant amount of work required to update them and to ensure that the quality of data is sufficient to support our digital aspirations. These include:

1. Enterprise resource planning

SAP is our core financial and asset management system. This is a 'best of breed' platform, however it requires a significant upgrade to remain supported and to unlock new capabilities.

2. GIS

In FY24 we upgraded our GIS platform to ESRI. This is the preferred GIS system platform for electricity distribution companies across the globe. The migration to ESRI included a transition from a basic geometric model to the more sophisticated Utility Network (UN) model. This platform will form the base of our geospatial model and gives us the ability to provide asset information in a more useful and accurate format.

3. Metering headend management

WEL invested in bringing the smart meter headend in house rather than remaining with a Software as a Solution (SaaS) out of the United States. The primary benefit of hosting the headend in NZ is it provides the network with greater flexibility in the development of tools and insights from the smart meter data. Two data centres geographically separated in New Zealand were selected to host the servers and associated equipment and to provide redundancy. By relocating the system to a New Zealand environment, system resiliency is improved, and the overall ownership cost is reduced. The project is part of WEL's commitment to increase its understanding and management of the Low Voltage Network, and to further develop DSO capabilities to help meet decarbonisation targets.

4. Network management system

GE PowerON is our core network management system (NMS) and it's the primary platform that supports our controllers in managing the real-time activities of the network, including the safety of any work undertaken. This platform has been well maintained and supported, but it is due for a routine upgrade which will be undertaken in late 2024.

5. Network visibility and insight systems

GridSight and PI Vision are the core of our new Distribution System Operator (DSO) platform. While the DSO is still in its formative phase, it is already delivering tangible business benefits to the network. These benefits and the DSO roadmap illustrate the opportunity for leveraging network data to improve the way that we design, build, manage, and operate the network. As the DSO platforms evolve, more work will be undertaken to provide robust two-way integration with other systems to fully realise the benefits from the DSO operating model.

6. Overhead network management

We have undertaken a LiDAR survey of our overhead network. We are currently exploring the potential of integrating this data into Neara, our line design software. This initiative will provide us with a 'digital twin' of our overhead network to enable modelling of differing weather conditions on the network, so we can then determine resilience improvement opportunities. It will also improve the efficiency and accuracy of our line designs and safety of work delivery.

7. Energy management

We are investigating systems that will actively visualise and manage energy flows within our network. The global drive for decarbonisation is seeing rapidly increasing uptake of DER, as it is critical that the energy flows are managed in a way that gives flexibility to both the customer and the network without massive interruption. This allows us to ensure that the network has the ability to predict load on the network, then defer load to non-peak periods in near real-time whenever appropriate. The deferral of load ensures that the network can be effectively managed without the need to 'over build' at significant additional cost.

Two additional platforms are going to be deployed to address missing architectural capabilities required to support our digital technology transformation. These are:

1. Integration

We have bespoke integration between our many systems; an integration platform will enable cheaper and more reliable integration between our current systems, and any new ones. While some systems make use of bespoke integration methods, others operate in isolation and require data to be manually updated across multiple systems at the same time. It's anticipated that the implementation project will start in FY25.

2. Data

Multiple silos of data exist across WEL's systems. There is significant untapped business value and a lot of useful information within these data assets. A robust and scalable approach to capturing and storing this data – as well as secure methods for reporting, analytics, and data-sharing across the business – is needed to ensure the best possible decision making.

2.4 FROM GOOD TO GREAT: OUR DISTRIBUTED SYSTEM OPERATOR (DSO) INITIATIVES

Historic planning methods have served us well in the past and resulted in a well-designed and managed network. However, given the changing landscape ahead of us, this would require changes far greater than the capacity and resources available and would drive a network that is unreliable and costly to operate. This would become a roadblock to both energy affordability and NZ's decarbonisation goals. There is a pressing need to decode the large volumes of information available to realise our ambitions. To enable these changes WEL created a DSO team in 2021. While still in the early stages of the transformation to the network operator of the future, exciting benefits are already being realised, and the team is constantly looking for new ways to address current and future scenarios.


Where to from here?

The WEL DSO strategy and roadmap was published in November 2021, the following diagram provides a simple view of where we are currently, and the next steps we are taking. You'll see our WEL DSO transformation is right in the middle of the Phase 1 implementation and we are close to kicking off our Phase 2 development projects. The first step in Phase 2 is our Distributed Energy Resources Management System (DERMS) implementation. In 2024 we will also kick off the phase 3 planning in parallel with Phase 2 in other workstreams. In this roadmap, we have identified the top six issues that must be addressed by taking a different approach, which include:

1. Operational safety risks due to data error and equipment failure – **Safety**
2. An aging network with more defects due to equipment deterioration – **Asset Integrity**
3. Higher energy cost, construction costs, labour costs and equipment costs – **Affordability**
4. Reduced system availability caused by frequently occurring major climatic events – **Resiliency**
5. Growth of new connections and higher capacity demand occurring at a rate faster than we can manage - **Electrification**
6. Consumer owned DERs and utility scale DERs causing reverse energy flow and subsequent power system constraints – **Compliance**

As presented in the DSO roadmap (refer to the diagram below), we have initiated the WEL DSO program to deliver this transformation program. All DSO work streams are inter-related but also have components that must be delivered sequentially, which makes program planning and resource management very challenging.

FIGURE 2 DSO strategy

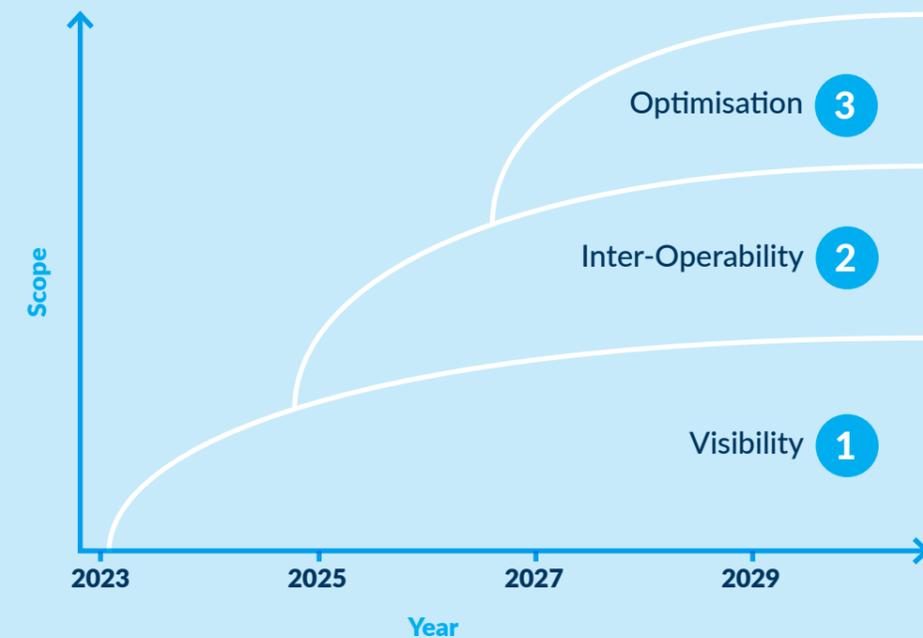

Benefits realised

Multiple benefits are being realised by WEL from the DSO R&D low voltage insights and tools being produced for business adoption. The outcomes from these insights address health and safety risk and cost savings for both customer and network. The following is a summary of achievements to date:

- Developed a pilot fault detection system for major event response.
- Data science and a new system to detect HV line down, neutral faults, LV burning conductors, as well as equipment failure prediction.
- Reinforcing the network metering system and proactively managing comms issues, faulty meters and obsolete equipment.
- A new DSO application to support new connection assessment process.
- Pilot solutions to address DER integration needs to avoid system overloading and supply compliance issues.
- New data analytic solutions to assist network planning functions.
- New systems to support network engineering and design functions.
- Engineering logic to detect network connectivity issues to support GIS development.
- Working with external aggregators, DER managers and retailers on developing non-network solutions and proving technology trials for an open network

Battery Energy Storage System



2.5 DISTRIBUTED ENERGY RESOURCES (DER)

Distributed Energy Resources (DER) are having an impact on the network and WEL believes that this impact will continue to grow. For NZ to realise its climate change goals the successful integration of DER will be critical. WEL has undertaken a number of different investments and studies to enable this future state.

Battery Energy Storage System (BESS)

On the 20th October 2023 WEL celebrated the launch of our Rotohiko Battery Energy Storage System (BESS). It's the culmination of a lot of hard work, creativity, innovation, and collaboration by many of our own talented people, our WEL Group subsidiaries, partner organisations, suppliers, and stakeholder groups.

The 35MWh BESS is the first battery at this scale in New Zealand and something we are proud of. It will deliver significant benefits by improving the resilience of the electricity system through the reserves market, while also increasing the value of intermittent renewable generation in the region.

Rotohiko is aligned to our long-term strategy, primarily ensuring that the delivery of electricity to our customers remains affordable. It achieves this through generating revenue via energy arbitrage. It's also capable of providing fast reserve support for the North Island grid, maximising the benefits of solar power as our own solar farm projects continue to develop.

The BESS can store enough energy to meet the daily demands of over 2,000 homes, and it will play an important role in reducing the need for non-renewable energy sources, actively lowering emissions in support of New Zealand's 2050 Net Zero target.

Solar farm development

WEL is focussed on supporting New Zealand's net carbon zero journey and are aligned to the United Nations Sustainable Development Goal #7 (Affordable and Clean Energy). Resource consents have been received for two solar farm sites near Rangiriri. The projects (10MW AC and 22.4MW AC) are in the final stages of engineering development for Board Final Investment Decision (FID). The projects once approved will be constructed through our subsidiary DER development company Infratec. It is anticipated to have at least one of the projects generating in the 1st quarter of 2025. The sites are embedded within WEL's 33kV network.

EV charger business unit

In 2021, WEL engaged two consulting firms to independently analyse the EV market in Europe, bring those insights back to a New Zealand context and forecast the impact to the WEL Network. The result was that by 2040, we would have to double the network from current valuation if no action was taken to manage the additional load and network peaks.

While the DSO is working closely with aggregators, WEL established an EV charger business unit in early 2022. Focusing initially on fleet operators, significant savings were made for customers through smart design and charging solutions that avoid costly network connection upgrades.

Unmanaged Residential EV's can cause congestion at peak periods which is part of the future challenge network owners face to ensure we enable new DER coming onto our network and maintain a reliable electricity supply.

One of WEL's responses to this challenge was for the business unit called We.EV to trial a residential customer EV charger solution as it is clear this market segment will have the greatest impact on the network. Through using an EV Charger platform, WEL can control the charger loads at network peaks if and when necessary via the DSO Distributed Energy Resource Management System (DERMS).



FIGURE 3 Residential EV charger impact


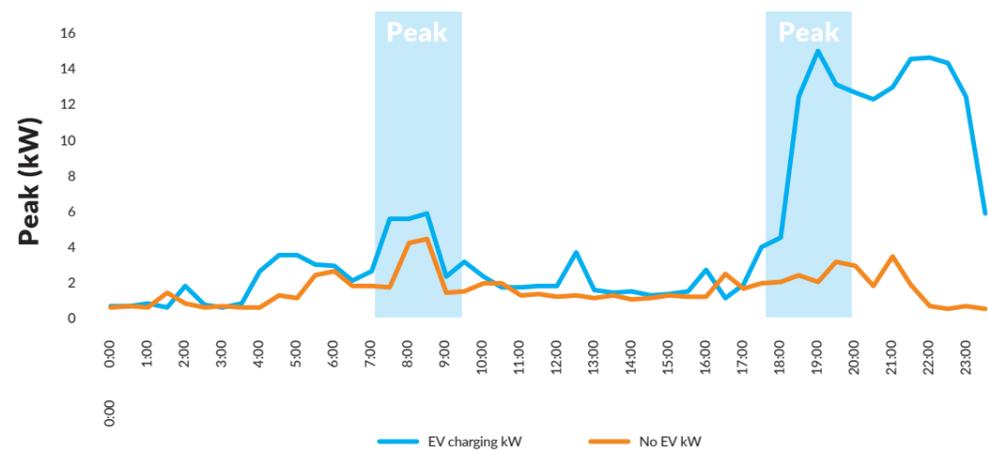


FIGURE 4 Customer usage profile

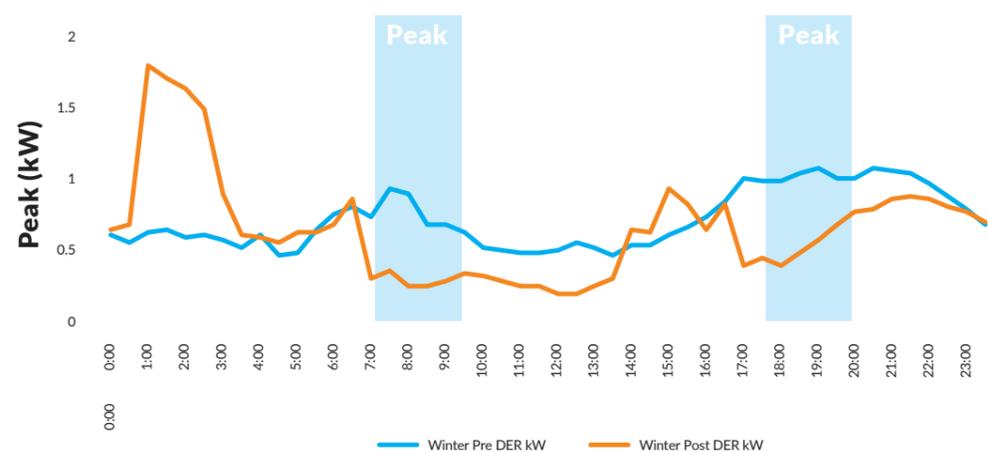

DER aggregators

New DER coming onto the network is both a challenge and an opportunity and depending on how they are utilised and managed can have both positive and negative impacts. Over the past 12 months we have seen a significant increase in DER connection requests, and in particular aggregators installing residential battery and solar systems. Managed DER that charges household batteries overnight from the network and throughout the day from solar while discharging through peak times can see a reduction in consumption during peak periods reducing costs to the end consumer. Figure 4 is an example of customers pre DER and post managed DER usage profiles.

Historically residential usage patterns have largely followed the same profile however, as more DER comes on, we are seeing a shift in consumer usage patterns. We are working with aggregators to understand both what impact they will have on our network, but also what services they may provide. Network alternatives (such as DER) may provide greater cost benefit value to our consumers as opposed to traditional methods of build as the nation electrifies.

CHAPTER 3
ASSET MANAGEMENT
PLAN UPDATE 2024
TE WHAKAHOUTANGA
MAHERE HUARAWA 2024

TOTAL NETWORK CAPEX

\$851.8M

DELTA



TOTAL NETWORK OPEX

\$124.1M

DELTA



TOTAL NON-NETWORK CAPEX

\$94.7M

DELTA



TOTAL NON-NETWORK OPEX

\$334.1M

DELTA



3 Where to from here?

3.1 A QUICK OVERVIEW

This section presents a high-level overview of the material changes to our forecasts and assumptions, and our related Network Development Plans, Asset Lifecycle Plans and Asset Management practices. Although you'll see that significant external factors continue to impact the organisation – delivering a safe, resilient, and reliable electricity network to meet our customers' needs remains our absolute priority. (It's also worth noting that for the expenditure plans discussed in this section, a material change is defined as >NZ\$500,000.)

3.1.1 What material changes are there to our inflation forecast?

Year-on-year inflation of input costs is normally around 2 – 3%. At the time of undertaking the analysis for this AMP the inflation forecast for FY25 was 2.3%, from FY26, it's expected to return to the normal inflation range for the planning period. To forecast as accurately as possible, we've used a forecast of annual CPI of 4.5% for FY2024, 2.3% for FY2025, and 2% from then on. Network CAPEX for the AMP period is forecast to increase by \$104.8M compared to last year, largely due to changes in CIW forecasts.

3.1.2 What material changes are there to underlying growth factors?

Economic growth

Hamilton's 2022 gross domestic product (GDP) grew at a rate of 4.1% to \$13.4 billion, against national GDP growth of 2.3%. GDP growth of 3.2% was experienced in the Waikato District in 2022 with the biggest contributors being manufacturing, construction, agriculture, forestry, and fishing.

Population growth

In 2023 we engaged the University of Waikato to provide insights into the future population growth for the WEL Networks region. Based upon this work, we have forecast population growth of 1.4% per year over the next 10 years. From this, we estimate that around 1,760 to 2,320 new dwellings will be built each year over the medium to long-term.

Demand forecast

In our 2023 AMP we forecast a significant and rapid slowdown in new residential development over the short-term. This slowdown has not actually effected our required delivery, and although recent discussions with developers suggest that activity will likely reduce through FY25, the downturn is unlikely to be as sharp as previously expected. By contrast, in the medium to long-term, demand resulting from EV adoption and electrification of industry is expected to increase markedly. Responding to these drivers will require significant expenditure in reticulation upgrades.


We've detailed our input assumptions (used to formulate the various growth scenarios) in the following table:

Our demand forecast scenarios are graphically presented in Figure 6. The scenario (Med) represents a balanced view of the many factors influencing demand and is used as a fair indicator in our network development decision-making processes.

FIGURE 5 WEL growth scenarios

	LOW	MEDIUM	HIGH
Scenario Description	Short Recession, Slow Recovery	Short Recession, Medium Recovery	No Recession,
Res Growth (as provided by CIW)	1750-2150 dwellings p.a.	1760-2320 dwellings p.a.	1780-2510 dwellings p.a.
Ind/Com Growth	1.5 MW p.a.-2027 onwards	2 MW p.a.-2027 onwards	3 MW p.a.-2027 onwards
Electrification	0.3 MW p.a.	0.5MW p.a. + 9MW of proposed projects	1.6MW p.a. +21 MW of proposed projects
EV Uptake contribution to Peak (as provided by We.EV)	33,323 EVs by 2034	41,653 EVs by 2034	91,947 EVs by 2034
Superhub Inland Port and Ruakura Structure Plan	Stage 1 supplied/Others Not Supplied by WEL	Stage 1 supplied/Others Not Supplied by WEL	Stage 1 supplied/Others Not Supplied by WEL
Sleepyhead Estate	Factory Only	Factory+Industrial	Factory+Industrial+Residential

FIGURE 6 WEL demand forecast (MW)

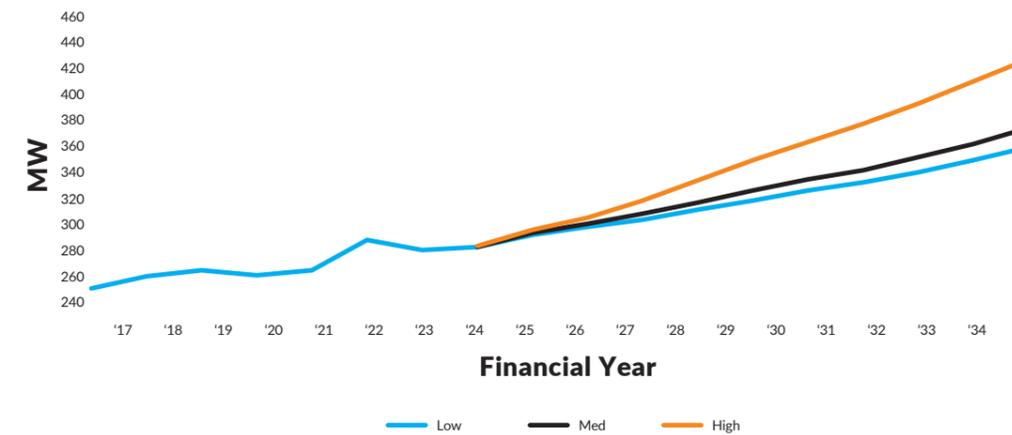

CAPEX - CUSTOMER INITIATED WORKS



CAPEX - NETWORK DEVELOPMENT



3.2 WHAT MATERIAL CHANGES ARE THERE TO FORECAST CAPITAL EXPENDITURE?

3.2.1 Customer Initiated Works (CIW)

The Customer Initiated Works (CIW) forecast includes consumer connections, new subdivision reticulation, asset relocation expenditure, and a provision for electrification, including greater uptake of solar PV and electric vehicles. As noted earlier, a short-term slowdown in residential expansion is expected compared with FY24. The same underlying economic drivers will likely contribute to a slowdown in EV adoption compared to the forecast in our 2023 AMP. While industrial and commercial enquiries remain strong, a downturn in activity in these sectors is expected in FY25.

In the longer term, increased demand is expected to be driven by residential intensification plans for Hamilton, increased investment in decarbonisation of industrial processes (electrification of process heat), EV uptake, and adoption of distributed generation and distributed energy resources. These growth drivers result in a \$95.1M increase in the CIW expenditure forecast from FY25 to FY33 compared to our 2023 AMP. This growth has been factored into our demand forecasts and is illustrated in the graph below in terms of capital expenditure (CAPEX).

3.2.2 Network development

Our Network Development Plan includes expenditure associated with system growth, assuring legislative and regulatory compliance, and improvements to reliability, safety, and environmental performance. There are few material changes, including bringing forward the delivery of several distribution feeder reliability projects identified in the 2023 AMP, and increased investment in fibre network projects to improve the performance and resilience of sub-transmission protection systems (which is reflected in our updated network communications strategy). Some system growth projects have been deferred in the short-term.

Resilient come rain or shine

The recent cyclones have highlighted the need for improved resilience of all critical infrastructure. Electrification to support the decarbonisation of the economy will increase the country's dependence on electrical infrastructure, further underscoring the importance of resilience in our sector. An additional investment of \$8.8M from FY26 to FY34 has been allocated to bolster the network against high impact, low probability (HILP) events. These funds will kickstart initiatives we identify through resilience gap analyses and risk studies.

Material changes at-a-glance

The following table summarises the material changes to Network Development projects presented in the 2023 AMP, along with our reasons for the changes (the specific need for these projects, and the options considered, are covered in the 2023 AMP and remain unchanged.)

The net effect of these changes and non-material adjustments is increased expenditure on Network Development of \$6.4M from FY25 to FY33 compared to our 2023 AMP. (Keep in mind that all costs are presented in FY24 dollars to facilitate comparison, and values will differ from those presented in the 2023 AMP.)

FIGURE 7 Customer Initiated Works (CIW) expenditure

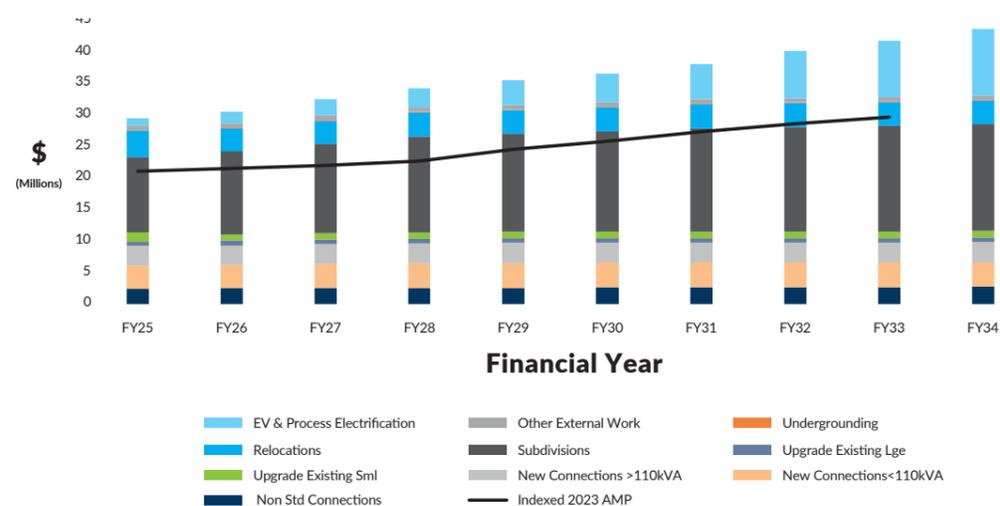


FIGURE 8 Network development expenditure

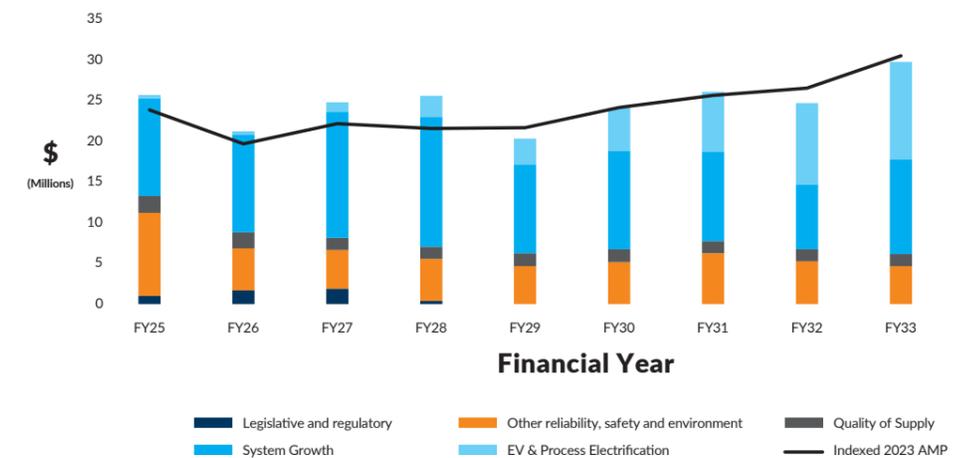




FIGURE 9 Network development projects

GXP	PROJECT NAME	2023 AMP		2024 AMP		REASON FOR CHANGE
		Timing	Cost (000's)	Timing	Cost (000's)	
ALL	Network Resilience Initiatives	N/A	N/A	FY26-FY34	\$8,750	New: Initiatives for enhancing WEL's resilience maturity driven by our resilience strategy currently under development
ALL	Provision for voltage management, & network reinforcement	FY29-FY33	\$1,417	FY30-FY34	\$6,086	Adjusted: Costs adjusted, to allow additional voltage management and network reinforcement projects
HAM33	Crosby Substation Twin	FY30-FY33	\$7,228	FY31-FY34	\$9,020	Adjusted: Cost adjusted based on recently completed substation projects. This cost has been benchmarked against other EDBs. Deferred: Based on re-forecasted loading in the area
HAM33	Fairfield Distribution Network	FY24-FY31	\$5,318	FY24-FY31	\$6,799	Adjusted: Cost adjusted based on recently completed projects
HAM33	BOR 33kV circuit uprating	FY25	\$541	FY25	\$1,496	Adjusted: Cost adjusted for additional underground sections
HAM33	Reconfiguration of Wallace feeder, WALCB2	FY25-FY26	\$539	FY25	\$1,060	Adjusted: Cost adjusted based on recently completed projects
HAM33	HAMCB2722 and HAMCB2742 Security	N/A	N/A	FY27	\$1,269	New: Introduced to allow for offloading of either half bus at the Hamilton 11kV zone substation
HLY33	FINCB4 New Feeder	FY27-FY28	\$548	FY26	\$1,436	Adjusted: Cost adjusted based on recently completed projects Accelerated: To address load growth in the south-eastern region of the Finlayson Rd zone substation
TWH33	KOH Distribution network	FY24-FY28	\$2,137	FY24-FY27	\$3,525	Adjusted: Cost adjusted based on recently completed projects Accelerated: based on reforecast growth
TWH33	Voltage Regulator and network upgrades on Gordonton feeders	FY25-FY26	\$1,927	FY25	\$835	Adjusted: Scope reduced as proposed projects did not demonstrate required benefit

CAPEX - ASSET RENEWAL




3.2.3 Asset replacement and renewal

Our asset replacement and renewal strategy remains aligned to those detailed in our 2023 AMP. It's our strategy to balance cost, risk, and performance drivers by maintaining a constant level of risk for our asset portfolio over the planning period. The long-term asset strategy is being reviewed and enhanced to better direct asset lifecycle decisions in the future. This strategy is expected to be in place by March 2024.

However, we've had to make a few adjustments to Asset Replacement and Renewal Plans – largely to improve investment efficiency, updated cost data, and a better understanding of asset performance and condition.

FIGURE 10 Asset renewal capital expenditure

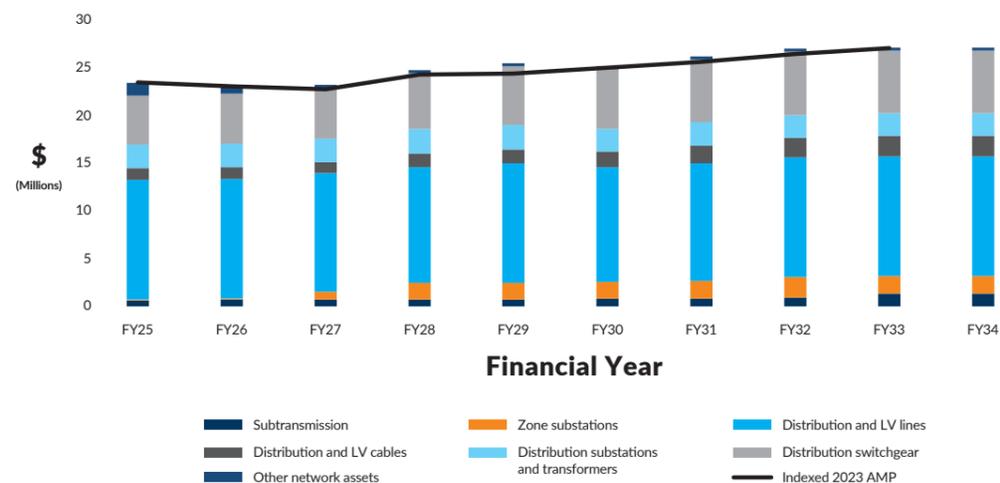

These include:

1. Capitalised vegetation management expenditure:

An additional budget has been made available to accommodate the capitalisation of vegetation works in conjunction with asset renewal projects. This will enable us to hold our Vegetation Management OPEX budget flat.

2. Increases in cost per unit:

This incorporates increases in labour, material, and services costs driven by inflation across all asset classes.

3. Increases in number of units addressed:

3.1 Ring main units

Additional ring main units have been included in the renewal programme. This is to counter the frequency of equipment failures and any related increase in risk to safety. This will increase the total number of units replaced over the 10 years – from 130 units to 175.

3.2 Air break switches

For the same reasons as the units above, we're increasing the total number of units replaced over the 10 years – from 130 units to 150.

3.3 Cables

Budget was allocated for proactive cable replacement in the 2023 AMP, and this will be carried forward for the planning period.

4. Decrease in pole replacements:

The number of poles to be replaced has been reduced from 220 to 160 per year over the planning period, starting from FY25. This is due to our improved understanding of the condition of the assets and updates to CBRM models.

5. Substation assets replaced:

Planned relay replacements at Chartwell substation have been consolidated to include replacement of the SCADA RTU device. Other substation asset classes that are included in this plan are consistent with the 2023 AMP.

These adjustments result in a total increase of \$3.3M from FY25 to FY33 compared to our 2023 AMP.

Like the Asset Renewal Capital Expenditure profile presented in the 2023 AMP, the years FY25-FY27 are relatively flat. From FY28 there is an increase in expenditure on ring main units, LV underground cables, and zone substation transformers, driven by asset age and condition.

NON-NETWORK CAPEX

FORECAST EXPENDITURE FROM FY25 THROUGH FY34

\$94.7M



FORECAST EXPENDITURE VS THE PLAN

NETWORK OPEX

FORECAST EXPENDITURE FROM FY25 THROUGH FY34

\$124.1M



FORECAST EXPENDITURE VS THE PLAN

3.2.4 Non-network CAPEX

This is expected to increase by \$23.5M compared to the 2023 AMP. Indexed to this year's costs, the changes can be summarised as:

Strategic projects	+\$13.1M
Routine non-network	+\$10.4M

The key changes since the last AMP are:

- Smart Meters and Easements included as non-network CAPEX \$11.2M
- Building and facilities costs updated - relating to a new building being constructed in FY25, and ongoing costs around the ageing existing building \$11.2M

3.3

WHAT MATERIAL CHANGES ARE THERE TO FORECAST OPERATIONAL EXPENDITURE?

3.3.1 Network OPEX

Material changes to forecast operational expenditure

Network operational Expenditure

Recently we have seen increases in our Network OPEX costs. This has been driven by increases in labour costs, service costs (e.g. traffic management), resource availability (e.g. Vegetation now covers three full teams), more accurate capture of actual costs compared to previous budget assumptions. This has resulted in an increase of \$13.5M from FY25 to FY33 compared to our 2023 AMP.

FIGURE 11 Non-network capital expenditure


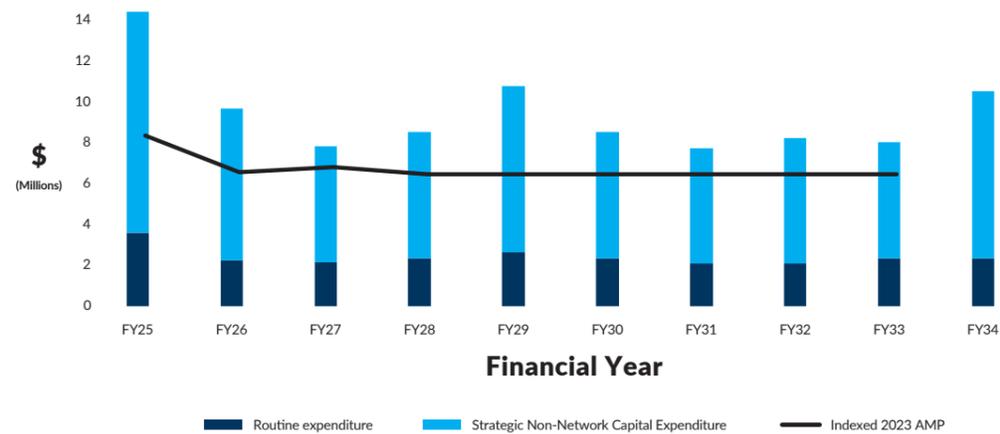


FIGURE 12 Network operational expenditure



OPEX - NON-NETWORK

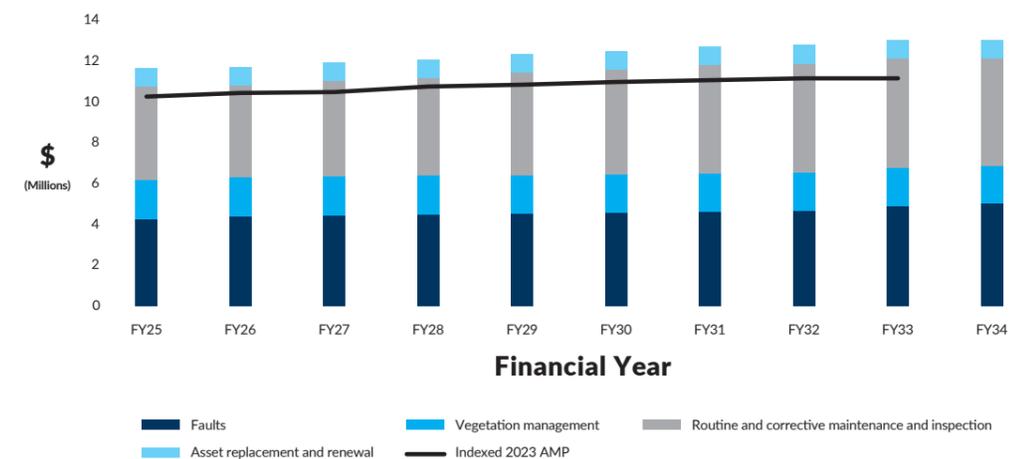

TOTAL CAPEX



3.3.2 OPEX - non-network

The changes in operational expenditure, from the 2023 AMP (indexed to this year's costs), over the previous AMP period, can be summarised as:

System operations	-\$5.9M
Business support	+\$49.7M

This has resulted in a total increase of \$43.8M, across the previous AMP period, as illustrated in Figure 13.

As outlined on pages 14-16 "Future Focused: Our Digital Journey", WEL is activating our digital strategy to ensure we remain in technical support, and we have the right digital capabilities in place to support the business and our customers in the years ahead.

A number of the platforms we are upgrading or implementing are now cloud based and/ or Software as a Service (SaaS) offerings, resulting in an annual operating expense rather than the traditional upfront capital expense (e.g. on-premise with perpetual licenses).

Looking to FY25, upgrading SAP to S/4Hana and implementing both Integration and Data Platforms is forecasted to result in additional OPEX of \$4M. In addition, upgrades / implementations forming our digital strategy are estimated to result in annual SaaS/ licence costs of \$4M p.a. into the future.

The activation of our digital strategy will ensure our business has systems and processes in place that allow our staff and contractors to make efficient decisions based on up-to-date data.

3.4 WHAT MATERIAL CHANGES ARE THERE TO FORECAST TOTAL CAPITAL EXPENDITURE?

3.4.1 Total CAPEX

The changes in capital expenditure, from the 2023 AMP (indexed to this year's costs), over the previous AMP period, can be summarised as a total increase of \$128.4M, as illustrated above.

The changes in capital expenditure, from the 2023 AMP (indexed to this year's costs), over the previous AMP period, can be summarised as:

Customer Initiated Works	+\$95.1M
Asset renewal	+\$3.3M
Network development	+\$6.4M
Non-network CAPEX	+\$23.5M

FIGURE 13 Non-network operational expenditure


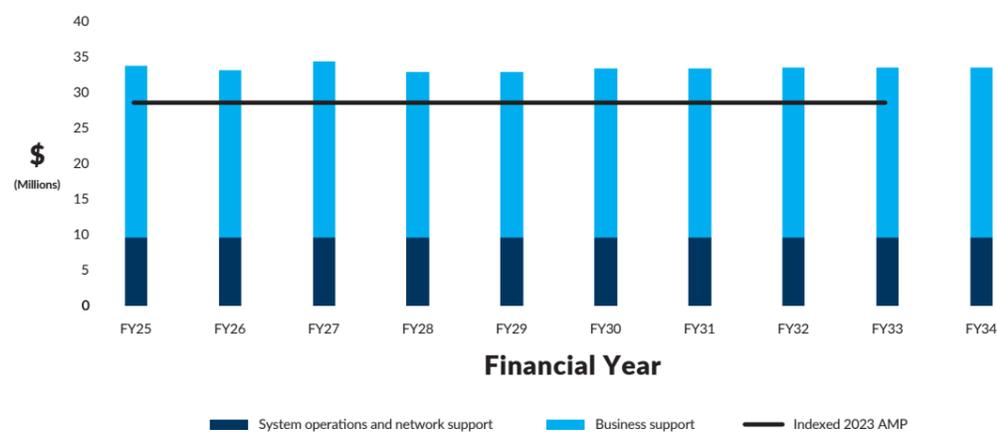


FIGURE 14 Total capital expenditure



TOTAL OPEX

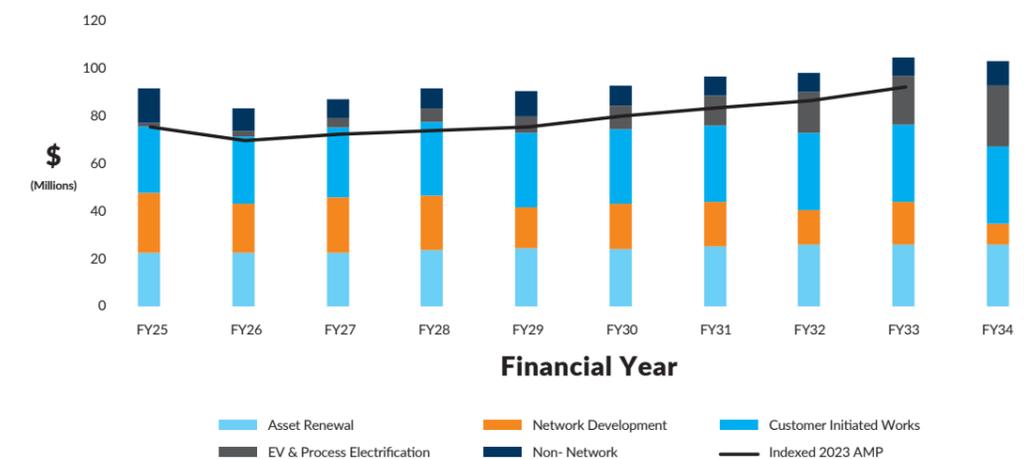


3.5 WHAT MATERIAL CHANGES ARE THERE TO FORECAST TOTAL OPERATIONAL EXPENDITURE?

3.5.1 Total OPEX

The changes in operational expenditure, from the 2023 AMP (indexed to this year's costs), over the previous AMP period, can be summarised as a total increase of \$57.3M, as illustrated above.

FIGURE 15 Total operational expenditure

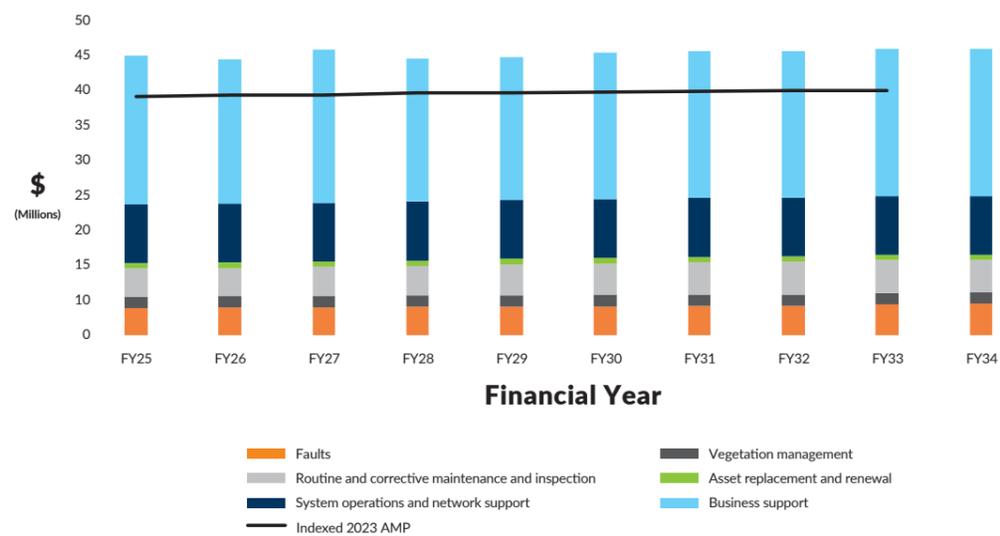

3.6 MATERIAL CHANGES TO ASSET MANAGEMENT PRACTICE

WEL is currently undertaking a project to gain certification to the ISO 55001 Standard, as part of a continuing effort to improve WEL's systems and capability. This means we will be able to deliver an appropriate balance of risk management, cost, and asset performance for the communities we serve. The international standard for asset management is recognised by the NZ Commerce Commission as evidence of exemplary practice.

3.7 MATERIAL CHANGES TO PLANNED NETWORK OUTAGES

In FY24 we are observing an increase in the amount of planned SAIDI impacting our network. This will result in an increase in SAIDI from 35.6 minutes (WEL target) to a forecast of 60 minutes. This increase is the result of additional planned work being delivered on our network, especially with the introduction of Tier 1 service providers. In FY25 we are forecasting an increase from historic values due to the volume of work we are undertaking. It is currently predicted that this will increase to 52 minutes.

Our performance has been very good when compared to the wider industry. However, we acknowledge that the reliance on electricity is increasing with a shift to a decarbonised economy. We are actively investigating methods to reduce outages as much as possible wherever it is cost effective. This includes reviewing our live line process, changing our network standards, and investing in plant and equipment including non-wire solutions.




CHAPTER 4

Schedules

Te Whakamōhiohio

AMP PLANNING PERIOD
1 APRIL 2024 -
31 MARCH 2034

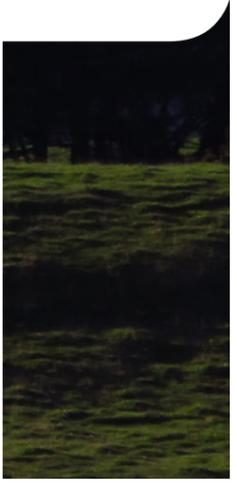

4.1 SCHEDULE 11A: Report on forecast capital expenditure

This schedule requires a breakdown of forecast expenditure on assets for the current disclosure year and a 10 year planning period. The forecasts should be consistent with the supporting information set out in the AMP.

The forecast is to be expressed in both constant price and nominal dollar terms. Also required is a forecast of the value of commissioned assets (i.e., the value of RAB additions).

EDBs must provide explanatory comment on the difference between constant price and nominal dollar forecasts of expenditure on assets in Schedule 14a (Mandatory Explanatory Notes).

EDBs must express the information in this schedule (11a) as a specific value rather than ranges. Any supporting information about these values may be disclosed in Schedule 15 (Voluntary Explanatory Notes).

This information is not part of audited disclosure information.

	Current Year CY	CY+1	CY+2	CY+3	CY+4	CY+5	CY+6	CY+7	CY+8	CY+9	CY+10
11a(i): Expenditure on Assets Forecast	\$000 (in nominal dollars)										
Consumer connection	31,229	25,029	27,157	29,750	32,077	33,990	35,908	38,293	41,407	44,113	47,281
System growth	11,817	12,301	12,597	17,219	19,707	15,284	19,167	20,676	20,550	27,616	22,516
Asset replacement and renewal	23,383	22,670	23,009	23,443	25,480	26,723	26,946	28,592	30,065	30,776	31,391
Asset relocations	4,503	4,327	3,797	3,960	4,137	4,220	4,305	4,391	4,474	4,564	4,655
Reliability, safety and environment:											
Quality of supply	2,065	2,137	2,009	1,571	1,592	1,678	1,678	1,689	1,735	1,722	1,805
Legislative and regulatory	893	1,086	1,805	1,956	499	-	-	-	-	-	-
Other reliability, safety and environment	6,340	10,128	5,243	5,015	5,391	5,098	5,763	7,050	6,042	5,507	4,063
Total reliability, safety and environment	9,298	13,351	9,058	8,542	7,482	6,776	7,442	8,739	7,777	7,229	5,868
EXPENDITURE ON NETWORK ASSETS	80,230	77,677	75,618	82,914	88,881	86,992	93,768	100,691	104,273	114,298	111,711
Expenditure on non-network assets	13,498	14,759	9,858	8,162	9,052	11,696	9,418	8,733	9,482	9,408	12,584
EXPENDITURE ON ASSETS	93,728	92,436	85,476	91,076	97,933	98,688	103,185	109,425	113,755	123,707	124,295
PLUS Cost of financing											
LESS Value of capital contributions	11,404	7,097	7,273	7,924	8,507	8,968	9,430	10,002	10,768	11,428	12,199
PLUS Value of vested assets											
CAPITAL EXPENDITURE FORECAST	82,324	85,339	78,203	83,152	89,426	89,720	93,756	99,423	102,987	112,278	112,096
Assets commissioned	81,306	85,189	78,560	82,905	89,112	89,705	93,554	99,139	102,809	111,814	112,105

4.1 SCHEDULE 11A: Report on forecast capital expenditure - Continued

	Current Year CY	CY+1	CY+2	CY+3	CY+4	CY+5	CY+6	CY+7	CY+8	CY+9	CY+10
	\$000 (in constant dollars)										
Consumer connection	31,229	25,029	26,624	28,595	30,227	31,401	32,523	34,003	36,047	37,650	39,563
System growth	11,817	12,301	12,350	16,550	18,570	14,120	17,360	18,360	17,890	23,570	18,840
Asset replacement and renewal	23,383	22,670	22,558	22,533	24,010	24,688	24,405	25,389	26,174	26,267	26,267
Asset relocations	4,503	4,327	3,723	3,807	3,898	3,898	3,900	3,899	3,895	3,896	3,895
Reliability, safety and environment:											
Quality of supply	2,065	2,137	1,970	1,510	1,500	1,550	1,520	1,500	1,510	1,470	1,510
Legislative and regulatory	893	1,086	1,770	1,880	470	-	-	-	-	-	-
Other reliability, safety and environment	6,340	10,128	5,140	4,820	5,080	4,710	5,220	6,260	5,260	4,700	3,400
Total reliability, safety and environment	9,298	13,351	8,880	8,210	7,050	6,260	6,740	7,760	6,770	6,170	4,910
EXPENDITURE ON NETWORK ASSETS	80,230	77,677	74,135	79,695	83,755	80,367	84,928	89,411	90,776	97,553	93,474
Expenditure on non-network assets	13,498	14,759	9,665	7,845	8,530	10,805	8,530	7,755	8,255	8,030	10,530
EXPENDITURE ON ASSETS	93,728	92,436	83,800	87,540	92,285	91,172	93,458	97,166	99,031	105,583	104,004

Subcomponents of expenditure on assets (where known)

*EDBs' must disclose both a public version of this Schedule (excluding cybersecurity cost data) and a confidential version of this Schedule (including cybersecurity costs)

Energy efficiency and demand side management,
reduction of energy losses

Overhead to underground conversion

11	116	116	115	115	114	114	114	113	113	113
----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----

Research and development

Cybersecurity (Commission only)

4.1 SCHEDULE 11A: Report on forecast capital expenditure - Continued

	Current Year CY	CY+1	CY+2	CY+3	CY+4	CY+5	CY+6	CY+7	CY+8	CY+9	CY+10
Difference between nominal and constant price forecasts	\$000										
Consumer connection	-	-	532	1,155	1,850	2,588	3,385	4,290	5,360	6,463	7,718
System growth	-	-	247	669	1,137	1,164	1,807	2,316	2,660	4,046	3,676
Asset replacement and renewal	-	-	451	910	1,470	2,035	2,540	3,203	3,892	4,509	5,124
Asset relocations	-	-	74	154	239	321	406	492	579	669	760
Reliability, safety and environment:											
Quality of supply	-	-	39	61	92	128	158	189	225	252	295
Legislative and regulatory	-	-	35	76	29	-	-	-	-	-	-
Other reliability, safety and environment	-	-	103	195	311	388	543	790	782	807	663
Total reliability, safety and environment	-	-	178	332	432	516	702	979	1,007	1,059	958
Expenditure on network assets	-	-	1,483	3,220	5,126	6,625	8,839	11,280	13,497	16,746	18,236
Expenditure on non-network assets	-	-	193	317	522	891	888	978	1,227	1,378	2,054
Expenditure on assets	-	-	1,676	3,537	5,649	7,516	9,727	12,259	14,724	18,124	20,291

Commentary on options and considerations made in the assessment of forecast expenditure

EDBs may provide explanatory comment on the options they have considered (including scenarios used) in assessing forecast expenditure on assets for the current disclosure year and a 10 year planning period in Schedule

4.1 SCHEDULE 11A:

Report on forecast capital expenditure - Continued

	Current Year CY	CY+1	CY+2	CY+3	CY+4	CY+5
11a(ii): Consumer Connection	\$000 (in constant prices)					
Consumer types defined by EDB*						
Residential Customers	23,735	17,134	18,579	19,612	20,745	21,156
Business Customers	405	1,298	1,403	1,717	2,094	2,572
Large Customers - Low Voltage 400V	7,089	5,328	5,438	5,565	5,690	5,978
Large Customers - Medium Voltage 11kV	-	562	500	1,000	1,000	1,000
Large Customers - High Voltage 33kV	-	-	-	-	-	-
External Works	-	707	704	700	697	695
*include additional rows if needed						
CONSUMER CONNECTION EXPENDITURE	31,229	25,029	26,624	28,595	30,227	31,401
LESS Capital contributions funding consumer connection	6,728	3,296	3,861	4,252	4,555	4,814
CONSUMER CONNECTION LESS CAPITAL CONTRIBUTIONS	24,501	21,733	22,763	24,342	25,671	26,587
	Current Year CY	CY+1	CY+2	CY+3	CY+4	CY+5
11a(iii): System Growth	\$000 (in constant prices)					
Subtransmission	1,085	1,496	2,420	1,220	470	-
Zone substations	6,347	2,206	2,760	8,280	11,110	6,550
Distribution and LV lines	-	-	-	-	-	-
Distribution and LV cables	3,617	8,599	6,970	6,450	5,690	5,960
Distribution substations and transformers	-	-	200	600	1,300	1,610
Distribution switchgear	768	-	-	-	-	-
Other network assets	-	-	-	-	-	-
SYSTEM GROWTH EXPENDITURE	11,817	12,301	12,350	16,550	18,570	14,120
LESS Capital contributions funding system growth						
SYSTEM GROWTH LESS CAPITAL CONTRIBUTIONS	11,817	12,301	12,350	16,550	18,570	14,120

	Current Year CY	CY+1	CY+2	CY+3	CY+4	CY+5
11a(iv): Asset Replacement and Renewal	\$000 (in constant prices)					
Subtransmission	379	655	743	737	719	735
Zone substations	134	124	110	757	1,707	1,673
Distribution and LV lines	14,248	12,104	12,151	12,091	11,768	12,165
Distribution and LV cables	1,936	1,136	1,138	1,113	1,345	1,416
Distribution substations and transformers	1,996	2,425	2,434	2,387	2,461	2,413
Distribution switchgear	4,277	5,009	5,006	5,141	5,708	5,990
Other network assets	413	1,216	976	307	301	295
ASSET REPLACEMENT AND RENEWAL EXPENDITURE	23,383	22,670	22,558	22,533	24,010	24,688
LESS Capital contributions funding asset replacement and renewal	469					
ASSET REPLACEMENT AND RENEWAL LESS CAPITAL CONTRIBUTIONS	22,914	22,670	22,558	22,533	24,010	24,688
	Current Year CY	CY+1	CY+2	CY+3	CY+4	CY+5
11a(v): Asset Relocations	\$000 (in constant prices)					
Project or programme*						
Undergrounding	11	116	116	115	115	114
*include additional rows if needed						
All other project or programmes - asset relocations	4,492	4,211	3,607	3,691	3,783	3,784
ASSET RELOCATIONS EXPENDITURE	4,503	4,327	3,723	3,807	3,898	3,898
LESS Capital contributions funding asset relocations	4,207	3,801	3,269	3,364	3,461	3,471
ASSET RELOCATIONS LESS CAPITAL CONTRIBUTIONS	296	526	454	443	437	428

4.1 SCHEDULE 11A:

Report on forecast capital expenditure - Continued

	Current Year CY	CY+1	CY+2	CY+3	CY+4	CY+5
11a(vi): Quality of Supply	\$000 (in constant prices)					
Project or programme*						
Network Upgrades Due To DG applications	69	-	-	-	-	-
Distribution transformer and LV feeder upgrade projects identified via smart meters	919	753	820	810	800	830
Power Quality Analyser Installation	507	635	550	110	110	110
Smart Meter Distribution Transformer Monitoring	570	749	600	590	590	610
*include additional rows if needed						
All other projects or programmes - quality of supply						
QUALITY OF SUPPLY EXPENDITURE	2,065	2,137	1,970	1,510	1,500	1,550
LESS Capital contributions funding quality of supply						
QUALITY OF SUPPLY LESS CAPITAL CONTRIBUTIONS	2,065	2,137	1,970	1,510	1,500	1,550

	Current Year CY	CY+1	CY+2	CY+3	CY+4	CY+5
11a(vii): Legislative and Regulatory	\$000 (in constant prices)					
Project or programme*						
Line clearance mitigation	597	-	330	320	-	-
NER protection changes through TWH Network	5	412	-	-	-	-
Seismic upgrades of substations	83	674	1,440	1,560	470	-
TUK Wind farm 33kV ET/NER Earth & EF pro	192					
HORCB6 Offload and 11kV reconfiguration of NGA feeders	16					
*include additional rows if needed						
All other projects or programmes - legislative and regulatory						
LEGISLATIVE AND REGULATORY EXPENDITURE	893	1,086	1,770	1,880	470	-
LESS Capital contributions funding legislative and regulatory						
LEGISLATIVE AND REGULATORY LESS CAPITAL CONTRIBUTIONS	893	1,086	1,770	1,880	470	-

4.1 SCHEDULE 11A:

Report on forecast capital expenditure - Continued

	Current Year CY	CY+1	CY+2	CY+3	CY+4	CY+5
11a(viii): Other Reliability, Safety and Environment	\$000 (in constant prices)					
Project or programme*						
Air-conditioning for substations	-	124	130	50	50	60
Daisy Chain Transformer Unbundling	293	627	270	270	270	280
Fibre installation (Discretionary)	55	60	70	70	80	80
Fibre routes	254	1,372	820	810	800	830
Glasgow Zone Substation Relocation	-	-	-	-	-	-
Gordonton Zone Substation Upgrade	195	-	-	-	-	-
IoT Network Measurement	82	106	270	270	270	280
LV visibility and data insights	251	428	350	340	340	350
Multi Circuit Rationalisation	-	-	-	-	-	350
Network Reliability Project	-	566	680	690	690	710
Melville Distribution Network Security	167	-	-	-	-	-
DSO Enabling	80	-	-	-	-	-
Garden Place Switching Station Bypass	438	-	-	-	-	-
LATCB5: X146 Back feed	435	-	-	-	-	-
Massey Switchgear Upgrade	726	-	-	-	-	-
Repeater Station DC System Upgrade STAT	59	-	-	-	-	-
SANCB3 River Rd Tie	431	-	-	-	-	-
Automated Distribution Equipment UHF Serial Radio Network Upgrade	228	-	-	-	-	-
SIM SS CB Fail Isolation Switch Commissioning	-	-	-	-	-	-
Raglan Area Resilience	320	4,392	-	-	-	-
Restricted Space Improvements	43	85	260	-	260	270
Te Uku Zone Substation Upgrade	2,283	1,329	-	-	-	-
Unplanned Project Carryover	-	500	-	-	-	-
WEACB6 Reliability Upgrade	-	539	500	-	-	-
Weavers Zone Substation Relocation	-	-	1,290	1,320	1,320	-
Zone substation oil containment	-	-	-	-	-	-
Network Resilience Initiatives	-	-	500	1,000	1,000	1,500
*include additional rows if needed						
All other projects or programmes - other reliability, safety and environment						
OTHER RELIABILITY, SAFETY AND ENVIRONMENT EXPENDITURE	6,340	10,128	5,140	4,820	5,080	4,710
LESS Capital contributions funding other reliability, safety and environment						
OTHER RELIABILITY, SAFETY AND ENVIRONMENT LESS CAPITAL CONTRIBUTIONS	6,340	10,128	5,140	4,820	5,080	4,710

	Current Year CY	CY+1	CY+2	CY+3	CY+4	CY+5
11a(ix): Non-Network Assets	\$000 (in constant prices)					
ROUTINE EXPENDITURE						
Project or programme*						
Computer Equipment	207	230	165	165	440	715
Computer Software	159	31	150	150	150	150
Property, Plant and Equipment	1,032	2,471	650	400	400	400
Motor Vehicles	-	-	-	180	90	90
Smartmeters	685	917	1,000	1,000	1,000	1,000
Easements	267	250	250	250	250	250
*include additional rows if needed						
All other projects or programmes - routine expenditure						
ROUTINE EXPENDITURE	2,350	3,899	2,215	2,145	2,330	2,605
ATYPICAL EXPENDITURE						
Project or programme*						
Buildings / Facilities	1,369	6,600	1,750	500	500	500
DSO Projects	1,959	1,710	1,200	1,200	1,200	1,200
ITRON Headend on prem	4,364	-	500	-	500	2,500
*include additional rows if needed						
ALL OTHER PROJECTS OR PROGRAMMES - ATYPICAL EXPENDITURE	3,456	2,550	4,000	4,000	4,000	4,000
Atypical expenditure	11,148	10,860	7,450	5,700	6,200	8,200
EXPENDITURE ON NON-NETWORK ASSETS	13,498	14,759	9,665	7,845	8,530	10,805

4.1 SCHEDULE 11B: Report on forecast operational expenditure

This schedule requires a breakdown of forecast operational expenditure for the disclosure year and a 10 year planning period. The forecasts should be consistent with the supporting information set out in the AMP. The forecast is to be expressed in both constant price and nominal dollar terms.

EDBs must provide explanatory comment on the difference between constant price and nominal dollar operational expenditure forecasts in Schedule 14a (Mandatory Explanatory Notes).

EDBs must express the information in this schedule (11b) as a specific value rather than ranges. If EDBs wish to provide any supporting information about these values, this may be disclosed in Schedule 15 (Voluntary Explanatory Notes).

This information is not part of audited disclosure information.

	Current Year CY	CY+1	CY+2	CY+3	CY+4	CY+5	CY+6	CY+7	CY+8	CY+9	CY+10
Operational Expenditure Forecast	\$000 (in nominal dollars)										
Service interruptions and emergencies	5,400	4,321	4,541	4,678	4,819	4,965	5,115	5,269	5,428	5,814	6,049
Vegetation management	1,712	1,865	1,902	1,940	1,979	2,019	2,059	2,100	2,142	2,185	2,229
Routine and corrective maintenance and inspection	1,654	4,612	4,639	4,893	5,095	5,469	5,660	5,946	6,111	6,221	6,269
Asset replacement and renewal	2,482	902	918	936	955	974	993	1,013	1,034	1,054	1,075
NETWORK OPEX	11,248	11,701	12,000	12,447	12,848	13,427	13,827	14,329	14,715	15,274	15,622
System operations and network support	9,418	9,570	9,761	9,957	10,156	10,359	10,566	10,777	10,993	11,213	11,437
Business support	16,925	24,178	23,996	25,852	24,694	25,213	26,295	26,848	27,413	27,990	28,580
NON-NETWORK OPEX	26,343	33,748	33,758	35,808	34,850	35,572	36,861	37,625	38,406	39,203	40,017
OPERATIONAL EXPENDITURE	37,591	45,448	45,757	48,255	47,698	48,999	50,688	51,954	53,121	54,477	55,639
	\$000 (in constant prices)										
Service interruptions and emergencies	5,400	4,321	4,452	4,496	4,541	4,587	4,633	4,679	4,726	4,962	5,061
Vegetation management	1,712	1,865	1,865	1,865	1,865	1,865	1,865	1,865	1,865	1,865	1,865
Routine and corrective maintenance and inspection	1,654	4,612	4,548	4,703	4,801	5,053	5,126	5,280	5,320	5,309	5,246
Asset replacement and renewal	2,482	902	900	900	900	900	900	900	900	900	900
NETWORK OPEX	11,248	11,701	11,764	11,964	12,107	12,404	12,523	12,724	12,811	13,036	13,072
System operations and network support	9,418	9,570	9,570	9,570	9,570	9,570	9,570	9,570	9,570	9,570	9,570
Business support	16,925	24,178	23,526	24,848	23,270	23,293	23,816	23,840	23,864	23,889	23,915
NON-NETWORK OPEX	26,343	33,748	33,096	34,418	32,840	32,863	33,386	33,410	33,434	33,459	33,485
OPERATIONAL EXPENDITURE	37,591	45,448	44,860	46,382	44,947	45,267	45,910	46,134	46,245	46,495	46,556

4.1 SCHEDULE 11B:

Report on forecast operational expenditure - Continued

	Current Year CY	CY+1	CY+2	CY+3	CY+4	CY+5	CY+6	CY+7	CY+8	CY+9	CY+10
Subcomponents of operational expenditure (where known)	\$000 (in constant prices)										
*EDBs' must disclose both a public version of this Schedule (excluding cybersecurity cost data) and a confidential version of this Schedule (including cybersecurity costs)											
Energy efficiency and demand side management, reduction of energy losses	283	360	360	360	360	360	360	360	360	360	360
Direct billing*	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Research and Development	65	50	50	50	50	50	50	50	50	50	50
Insurance	811	959	1,055	1,161	1,277	1,404	1,545	1,699	1,869	2,056	2,262
Cybersecurity (Commission only)											
* Direct billing expenditure by suppliers that direct bill the majority of their consumers											
	Current Year CY	CY+1	CY+2	CY+3	CY+4	CY+5	CY+6	CY+7	CY+8	CY+9	CY+10
Difference between nominal and real forecasts	\$000										
Service interruptions and emergencies	-	-	89	182	278	378	482	590	703	852	987
Vegetation management	-	-	37	75	114	154	194	235	277	320	364
Routine and corrective maintenance and inspection	-	-	91	190	294	417	534	666	791	911	1,023
Asset replacement and renewal	-	-	18	36	55	74	94	114	134	154	176
NETWORK OPEX	-	-	235	483	741	1,023	1,303	1,605	1,905	2,238	2,550
System operations and network support	-	-	191	387	586	789	996	1,207	1,423	1,643	1,867
Business support	-	-	471	1,004	1,424	1,920	2,479	3,008	3,548	4,101	4,666
Non-network opex	-	-	662	1,390	2,010	2,709	3,475	4,215	4,971	5,744	6,533
OPERATIONAL EXPENDITURE	-	-	897	1,874	2,751	3,731	4,778	5,820	6,876	7,981	9,083

Commentary on options and considerations made in the assessment of forecast expenditure

EDBs may provide explanatory comment on the options they have considered (including scenarios used) in assessing forecast operational expenditure for the current disclosure year and a 10 year planning period in Schedule 15.

4.2 SCHEDULE 12A: Report on asset condition

This schedule requires a breakdown of asset condition by asset class as at the start of the forecast year.

The data accuracy assessment relates to the percentage values disclosed in the asset condition columns. Also required is a forecast of the percentage of units to be replaced in the next 5 years.

All information should be consistent with the information provided in the AMP and the expenditure on assets forecast in Schedule 11a.

All units relating to cable and line assets, that are expressed in km, refer to circuit lengths.

Asset condition at start of planning period (percentage of units by grade)

Voltage	Asset category	Asset class	Units	H1	H2	H3	H4	H5	Grade unknown	Data accuracy (1-4)	% of asset forecast to be replaced in next 5 years
All	Overhead Line	Concrete poles / steel structure	No.	0.04%	0.20%	4.76%	48.69%	46.03%	0.28%	3	3.57%
All	Overhead Line	Wood poles	No.	0.08%	1.01%	11.25%	43.95%	43.33%	0.38%	3	9.91%
All	Overhead Line	Other pole types	No.	0.08%	1.01%	11.25%	43.95%	43.33%	0.38%	2	-
HV	Subtransmission Line	Subtransmission OH up to 66kV conductor	km	-	0.87%	6.39%	28.25%	64.48%	-	1	-
HV	Subtransmission Line	Subtransmission OH 110kV+ conductor	km	-	-	-	-	-	-	N/A	-
HV	Subtransmission Cable	Subtransmission UG up to 66kV (XLPE)	km	-	-	2.00%	11.15%	86.85%	-	1	-
HV	Subtransmission Cable	Subtransmission UG up to 66kV (Oil pressurised)	km	-	-	-	-	-	-	N/A	-
HV	Subtransmission Cable	Subtransmission UG up to 66kV (Gas pressurised)	km	-	-	-	-	-	-	N/A	-
HV	Subtransmission Cable	Subtransmission UG up to 66kV (PILC)	km	-	-	-	3.43%	96.57%	-	1	-
HV	Subtransmission Cable	Subtransmission UG 110kV+ (XLPE)	km	-	-	-	-	-	-	N/A	-
HV	Subtransmission Cable	Subtransmission UG 110kV+ (Oil pressurised)	km	-	-	-	-	-	-	N/A	-
HV	Subtransmission Cable	Subtransmission UG 110kV+ (Gas Pressurised)	km	-	-	-	-	-	-	N/A	-
HV	Subtransmission Cable	Subtransmission UG 110kV+ (PILC)	km	-	-	-	-	-	-	N/A	-
HV	Subtransmission Cable	Subtransmission submarine cable	km	-	-	-	-	-	-	N/A	-
HV	Zone substation Buildings	Zone substations up to 66kV	No.	-	-	15.15%	84.85%	-	-	4	-
HV	Zone substation Buildings	Zone substations 110kV+	No.	-	-	-	-	-	-	N/A	-
HV	Zone substation switchgear	22/33kV CB (Indoor)	No.	-	-	10.91%	7.27%	81.82%	-	4	-
HV	Zone substation switchgear	22/33kV CB (Outdoor)	No.	-	-	6.06%	6.06%	87.88%	-	4	-
HV	Zone substation switchgear	33kV Switch (Ground Mounted)	No.	-	-	-	-	-	-	N/A	-
HV	Zone substation switchgear	33kV Switch (Pole Mounted)	No.	-	-	-	-	100.00%	-	4	-
HV	Zone substation switchgear	33kV RMU	No.	-	-	-	77.27%	22.73%	-	4	-
HV	Zone substation switchgear	50/66/110kV CB (Indoor)	No.	-	-	-	-	-	-	N/A	-
HV	Zone substation switchgear	50/66/110kV CB (Outdoor)	No.	-	-	-	-	-	-	N/A	-
HV	Zone substation switchgear	3.3/6.6/11/22kV CB (ground mounted)	No.	-	-	-	-	-	-	N/A	-
HV	Zone substation switchgear	3.3/6.6/11/22kV CB (pole mounted)	No.	-	-	-	-	-	-	N/A	-

4.2 SCHEDULE 12A: Report on asset condition - Continued

Asset condition at start of planning period (percentage of units by grade)

Voltage	Asset category	Asset class	Units	H1	H2	H3	H4	H5	Grade unknown	Data accuracy (1-4)	% of asset forecast to be replaced in next 5 years
HV	Zone Substation Transformer	Zone Substation Transformers	No.	-	-	-	18.37%	81.63%	-	3	-
HV	Distribution Line	Distribution OH Open Wire Conductor	km	-	1.01%	18.18%	34.05%	46.75%	-	3	2.48%
HV	Distribution Line	Distribution OH Aerial Cable Conductor	km	-	-	-	-	-	-	N/A	-
HV	Distribution Line	SWER conductor	km	-	-	-	-	-	-	N/A	-
HV	Distribution Cable	Distribution UG XLPE or PVC	km	-	-	12.52%	12.12%	75.36%	-	1	-
HV	Distribution Cable	Distribution UG PILC	km	-	-	-	47.26%	52.74%	-	1	-
HV	Distribution Cable	Distribution Submarine Cable	km	-	-	-	-	-	-	N/A	-
HV	Distribution switchgear	3.3/6.6/11/22kV CB (pole mounted) - reclosers and sectionalisers	No.	-	-	2.48%	13.04%	73.29%	11.18%	4	3.66%
HV	Distribution switchgear	3.3/6.6/11/22kV CB (Indoor)	No.	-	1.61%	10.34%	6.90%	81.15%	-	4	20.25%
HV	Distribution switchgear	3.3/6.6/11/22kV Switches and fuses (pole mounted)	No.	0.11%	1.37%	8.47%	21.17%	61.90%	6.98%	4	4.40%
HV	Distribution switchgear	3.3/6.6/11/22kV Switch (ground mounted) - except RMU	No.	-	-	-	-	-	-	N/A	-
HV	Distribution switchgear	3.3/6.6/11/22kV RMU	No.	-	0.35%	9.04%	40.39%	47.59%	2.63%	3	14.32%
HV	Distribution Transformer	Pole Mounted Transformer	No.	-	0.38%	2.64%	4.42%	74.04%	18.52%	3	6.61%
HV	Distribution Transformer	Ground Mounted Transformer	No.	0.05%	0.38%	3.84%	25.52%	48.34%	21.86%	3	5.59%
HV	Distribution Transformer	Voltage regulators	No.	-	-	8.70%	-	50.00%	41.30%	4	6.90%
HV	Distribution Substations	Ground Mounted Substation Housing	No.	-	-	-	-	-	-	N/A	-
LV	LV Line	LV OH Conductor	km	-	1.01%	18.18%	34.05%	46.75%	-	1	-
LV	LV Cable	LV UG Cable	km	-	-	21.90%	35.34%	42.76%	-	1	-
LV	LV Streetlighting	LV OH/UG Streetlight circuit	km	-	0.65%	8.90%	8.04%	82.41%	-	1	-
LV	Connections	OH/UG consumer service connections	No.	-	-	-	-	-	-	N/A	-
All	Protection	Protection relays (electromechanical, solid state and numeric)	No.	-	4.29%	8.34%	10.25%	77.12%	-	3	11.95%
All	SCADA and communications	SCADA and communications equipment operating as a single system	Lot	-	-	9.26%	17.90%	72.84%	-	3	4.18%
All	Capacitor Banks	Capacitors including controls	No.	-	-	-	-	100.00%	-	4	-
All	Load Control	Centralised plant	Lot	-	-	-	-	-	100.00%	3	-
All	Load Control	Relays	No.	-	-	-	-	-	-	N/A	-
All	Civils	Cable Tunnels	km	-	-	-	-	-	-	N/A	-

4.3 SCHEDULE 12B: Report on forecast capacity

This schedule requires a breakdown of current and forecast capacity and utilisation for each zone substation and current distribution transformer capacity.

The data provided should be consistent with the information provided in the AMP.

Information provided in this table should relate to the operation of the network in its normal steady state configuration.

12b(i): System Growth - Zone Substations

Existing Zone Substations	Current Peak Load (MVA)	Installed Firm Capacity (MVA)	Security of Supply Classification (type)	Transfer Capacity (MVA)	Utilisation of Installed Firm Capacity %	Installed Firm Capacity +5 years (MVA)	Utilisation of Installed Firm Capacity +5 yrs %	Installed Firm Capacity Constraint +5 years (cause)	Explanation
Avalon Dr	16	23	N-1	10	68%	23	78%	No constraint within +5 years	
Borman	19	21	N-1	11	91%	23	113%	Subtransmission circuit	Limited by the 33kV OH conductor current rating. Planned project for FY25 will address capacity constraint till FY27 after which load will be transferred to Gordonton substation following 11kV feeder upgrades and Chartwell substation once new substations Fairfield and Crosby are built.
Bryce St	14	23	N-1	5	60%	23	92%	Transformer	Planned offload to nearby substations.
Chartwell	17	23	N-1	11	72%	23	74%	No constraint within +5 years	
Claudelands	19	23	N-1	15	83%	23	133%	Transformer	Planned offload to new Fairfield zone substation and Chartwell zone substation.
Cobham	12	23	N-1	7	54%	23	72%	No constraint within +5 years	
Finlayson Rd	4	-	N	3	-	-	-	No constraint within +5 years	
Glasgow St	8	-	N	5	-	-	-	No constraint within +5 years	
Gordonton	8	5	N-1	6	157%	5	157%	Transformer	Currently meets WEL network security criteria through 11kV backfeeds. Transformer capacity will be reviewed when transformer renewals due at end of AMP period.
Hampton Downs	2	-	N	3	-	-	-	No constraint within +5 years	
Hoeka Rd	7	-	N	9	-	-	-	No constraint within +5 years	Meets security of supply requirements. Industrial load step growth excluded in forecasts due to uncertainty.
Horotiu	12	18	N-1	10	69%	18	137%	Transformer	New Kohia substation planned to support industrial and residential development FY24 - FY25.
Kent St	17	23	N-1	8	72%	23	65%	No constraint within +5 years	
Latham Court	17	23	N-1	10	76%	23	103%	Transformer	Planned offload to nearby substations.
Ngaruawahia	6	9	N-1	5	62%	9	59%	No constraint within +5 years	
Peacockes Rd	15	23	N-1	10	65%	23	80%	No constraint within +5 years	New Airport substation planned to support industrial and residential development FY28 - FY31.
Pukete	24	30	N-1	9	80%	30	89%	No constraint within +5 years	Te Rapa co-generation already been decommissioned Jun 2023. Pukete Anchor + WEL 11kV load on primary winding will exceed transformer primary 30MVA rating without intervention. Subtransmission cables carry a portion of Sandwich Rd, Tasman, Kent St, Horotiu load. Current work programme to repair cable joints will restore firm capacity. Planned offload to new Kohia zone substation starting FY24 will bring load within firm capacity.
Raglan	5	-	N	4	-	-	-	Subtransmission circuit	Planned Raglan 33kV resilience project, FY25.
Sandwich Rd	20	23	N-1	14	89%	23	101%	Subtransmission circuit	Planned 33kV overhead circuit & river crossing re-tensioning, FY25.
Tasman	21	23	N-1	18	89%	23	109%	Transformer	New Exelby substation planned to support Industrial and residential development FY25-FY29.
Te Kauwhata	7	10	N-1	3	66%	10	134%	Transformer	Industrial and residential customer dependent growth. Size of transformer will be considered closer to time of renewal.
Te Uku	2	5	N	2	38%	5	42%	No constraint within +5 years	
Wallace Rd	10	15	N-1	9	65%	15	78%	No constraint within +5 years	
Weavers	11	9	N-1	7	127%	9	127%	Transformer	Load can be transferred to the adjacent Glasgow St Substation in the event of a transformer outage. Planned projects to increase transfer capacity within Huntly area.
Whatawhata	5	-	N	3	-	-	-	No constraint within +5 years	

¹ Extend forecast capacity table as necessary to disclose all capacity by each zone substation

4.4 SCHEDULE 12C: Report on forecast network demand

This schedule requires a forecast of new connections (by consumer type), peak demand and energy volumes for the disclosure year and a 5 year planning period.

The forecasts should be consistent with the supporting information set out in the AMP as well as the assumptions used in developing the expenditure forecasts in Schedule 11a and Schedule 11b and the capacity and utilisation forecasts in Schedule 12b.

12c(i): Consumer Connections

Number of ICPs connected during year by consumer type	Number of connections					
	Current Year CY	CY+1	CY+2	CY+3	CY+4	CY+5
Consumer types defined by EDB*						
Residential Customers	1,822	1,458	1,618	1,942	2,038	2,066
Business Customers	69	55	61	74	77	78
Large Customers - Low Voltage 400V	25	20	22	27	28	28
Large Customers - Medium Voltage 11kV	2	2	2	2	2	2
Large Customers - High Voltage 33kV	2	2	2	2	2	2
CONNECTIONS TOTAL	1,920	1,536	1,705	2,046	2,148	2,177

*include additional rows if needed

Distributed generation

Number of connections made in year	695	845	975	1,105	1,236	1,366
Capacity of distributed generation installed in year (MVA)	40	28	17	6	6	7

12c(ii) System Demand

	Number of connections					
	Current Year CY	CY+1	CY+2	CY+3	CY+4	CY+5
Maximum coincident system demand (MW)						
GXP demand	281	291	298	306	314	323
PLUS Distributed generation output at HV and above	31	31	31	31	31	31
MAXIMUM COINCIDENT SYSTEM DEMAND	312	322	329	337	345	354
LESS Net transfers to (from) other EDBs at HV and above						
DEMAND ON SYSTEM FOR SUPPLY TO CONSUMERS' CONNECTION POINTS	312	322	329	337	345	354
Electricity volumes carried (GWh)						
Electricity supplied from GXPs	1,236	1,253	1,271	1,288	1,307	1,325
LESS Electricity exports to GXPs	51	51	51	51	51	51
PLUS Electricity supplied from distributed generation	283	287	291	295	299	303
LESS Net electricity supplied to (from) other EDBs	(16)	(16)	(16)	(16)	(16)	(16)
ELECTRICITY ENTERING SYSTEM FOR SUPPLY TO ICPS	1,483	1,505	1,526	1,548	1,570	1,593
LESS Total energy delivered to ICPS						
	1,404	1,424	1,444	1,464	1,485	1,506
LOSSES	79	80	82	84	85	87
LOAD FACTOR	54%	53%	53%	52%	52%	51%
LOSS RATIO	5.3%	5.3%	5.4%	5.4%	5.4%	5.5%

4.5 SCHEDULE 12D: Report forecast interruptions and duration

This schedule requires a forecast of SAIFI and SAIDI for disclosure and a 5 year planning period.

The forecasts should be consistent with the supporting information set out in the AMP as well as the assumed impact of planned and unplanned SAIFI and SAIDI on the expenditures forecast provided in Schedule 11a and Schedule 11b.

SAIDI	Current Year CY	CY+1	CY+2	CY+3	CY+4	CY+5
Class B (planned interruptions on the network)	57.4	52.0	52.0	52.0	52.0	52.0
Class C (unplanned interruptions on the network)	54.3	69.5	69.5	69.5	69.5	69.5

SAIFI	Current Year CY	CY+1	CY+2	CY+3	CY+4	CY+5
Class B (planned interruptions on the network)	0.45	0.45	0.45	0.45	0.45	0.45
Class C (unplanned interruptions on the network)	1.02	1.02	1.02	1.02	1.02	1.02

4.6 SCHEDULE 14A: Mandatory Explanatory Notes on Forecast Information

- 1 This Schedule requires EDBs to provide explanatory notes to reports prepared in accordance with clause 2.6.6.

This Schedule is mandatory—EDBs must provide the explanatory comment specified below, in accordance with clause 2.7.2. This information is not part of the audited disclosure information, and so is not subject to the assurance requirements specified in section 2.8.

Commentary on difference between nominal and constant price capital expenditure forecasts (Schedule 11a)

2. In the box below, comment on the difference between nominal and constant price capital expenditure for the current disclosure year and 10-year planning period, as disclosed in Schedule 11a.

Box 1: Commentary on difference between nominal and constant price capital expenditure forecasts

The inflation forecasts for the 10-year planning period are based on the May 2023 monetary policy statement from Reserve Bank

Commentary on difference between nominal and constant price operational expenditure forecasts (Schedule 11b)

3. In the box below, comment on the difference between nominal and constant price operational expenditure for the current disclosure year and 10-year planning period, as disclosed in Schedule 11b.

Box 2: Commentary on difference between nominal and constant price operational expenditure forecasts

(as per commentary above)



CHAPTER 5
TRANCHE 1 AMENDED
INFORMATION REQUIREMENTS
WĀHANGA 1 NGĀ HERENGA
PĀRONGO KUA PANONIHIĀ

5.1 AMENDMENT Q1

Expand ID requirements related to how much notice of planned interruptions is given to consumers, including planned interruptions that are booked but not carried out.

REFERENCE	REQUIREMENT	AMP DOCUMENT REFERENCE
Q1A - Narrative disclosure	Describe how WEL provides notice and communicates planned and unplanned interruptions, including any plans for changes or improvements in this area	2023 AMP 5.3.3

SUMMARY OF OUR APPROACH

Planned outages

A network request system is utilised to apply for the outage within the WEL Advanced Distribution Management System (ADMS). The date, time, customer impact, and mitigation methods are assessed and approved. An EIEP5A file identifying the affected transformers, date, shutdown start and end time is auto generated and sent to the Electricity Authority Outage Portal a minimum of 10 days prior to the outage date. This portal is accessed by retailers to produce individual customer outage notifications.

The notification process automatically generates a scheduled outage, which is published on the outage page on the WEL website in both list and graphical overlay format. Cancellations, time, and date changes greater than 24 hours prior to the notified outage are communicated to the retailer. A new EIEP5A file is sent to the EA Outage Portal and the outage map is updated automatically.

Overruns, cancellations, time, and date changes within 24 hours prior to the notified outage are updated in the outage map and as a courtesy an EIEP5A file is generated and sent to the EA Portal.

Unplanned outages

An unplanned outage caused by a fault or emergency switching, automatically generates an EIEP5B file and updates the current outage map. An Estimated Time to Restoration is automatically applied and is updated as the fault cause and remedial actions are identified.

Call centre

We have an in-house Customer Call Centre during standard business hours and utilise a third-party call centre outside of business hours. The ADMS generates outage notifications to selected groups and people including the third-party call centre who generate automated outage messaging which is played to all incoming calls.

5.2 AMENDMENT Q2

Add ID requirements on power quality.

REFERENCE	REQUIREMENT	AMP DOCUMENT REFERENCE
Q2 - Narrative disclosure	Requirement for EDBs (electricity distribution businesses) to describe their practices for monitoring voltage (including any plans for improvements) including:	
Q2(i)	What the EDB (electricity distribution businesses) is doing to develop and improve practices for monitoring voltage quality on its low voltage (LV) network (e.g., the EDB may provide reference to any work they are undertaking with other companies)	2023 AMP 6.5.2 and 6.7.2 2024 AMP 2.3 and 2.4
Q2(ii)	What work the EDB is doing on their LV network to address any known non-compliance with the applicable voltage requirements of the Electricity (Safety) Regulations 2010;	2023 AMP 4.2.2, 6.7.2 and 6.9
Q2(iii)	How the EDB is responding to and reporting on voltage quality issues when it identifies them, or they are raised by a stakeholder (e.g., the EDB may provide reference to performance over the previous period to give the forward plan context);	2023 AMP 6.7.2
Q2(iv)	How the EDB is communicating the work it is doing to improve voltage quality on its LV network to affected consumers	2023 AMP 5.3 and 6.7.2

SUMMARY OF OUR APPROACH

We aspire to being 'Best in Service.' Our objective is to provide excellent customer service and network performance. We believe that relationships in our community, with businesses, councils and community groups are vital to our success.

Customer experience objectives

Customer experience is a measure of how customers feel about the service received from us. Customer experience includes the level of network reliability each customer receives, how we interact with them, the value derived from the services we provide and the information we supply about our network. The objectives for achieving 'Best in Service' are:

- Delivery of electricity at the service level sought by our customers.
- Customers know who we are and can contact us across multiple mediums media.
- Providing meaningful feedback that customers understand and know we will act on.
- Customers value the services we offer and can rely on us to meet their needs.
- WEL is 'partner of choice' within the community and within the industry.

Power quality

Power quality describes the stability and conformity of the power supply in terms of voltage magnitude, frequency, and waveform required for the safe, and continuous operation of network and customer electrical equipment. Power quality issues include transient disturbances, harmonics, steady-state deviations, and equipment compatibility.

EDBs are required to comply with NZ Regulations. The evolving topology of distribution networks, nature, characteristics and profiles of loads and DER means that power quality may need increased monitoring than historically undertaken. We currently monitor power quality at various points in the distribution network:

- Grid Exit Points (GXP) through installed monitoring devices, as well as market information.
- Selected zone substations.
- Selected 11kV feeders.
- Selected distribution transformers.
- At the customer end through smart meters (for residential customers).

We are improving the accuracy of power quality monitoring through increasing the number of monitoring devices and proportion of the network being monitored.

Quality of supply including voltage regulation is a key driver for our network development plans. The key projects to address voltage issues are detailed in section 6.9 of our 2023 AMP.

LV visibility, data analytics and load profiles

A foundational element of enabling flexible networks and non-wire solutions is statistical and time-based information, on load and generation profiles at all levels of the network. To increase the resolution of information, we are investing in network monitoring equipment at the LV level.

Data analytics are applied to the load and power quality information from smart meter and Power Quality (PQ) analysers to create statistical demand profiles for each customer group. This establishes a baseline for current customer behaviour, and is used to locate potential flexible demand, and increasing the certainty of large customer connection requests.

Information from smart meters and PQ analysers upstream of groups of customers (e.g. at distribution transformers) is used to validate finer customer load profiles and estimate load profiles for customers on parts of the network without our smart meters.

Our DSO roadmap enhances visibility using smart meters. The smart meter data enables innovative practices and is presently used to manage 12 issue types across the LV network including broken neutral connections. This visibility enabled further innovation in trials for DER interfacing and DERMS (Distributed Energy Resource Management System).

Examples are detailed below:

Application area 1 – Coordinated voltage profile study

This study was designed to investigate using voltage data to plot aggregated distribution transformer level voltages in order to support a voltage compliance study at both distribution transformer and ICP (Installation Control Point) levels. Non-compliant locations are further investigated by assessing the individual ICP level profile, loading data, phase imbalances, etc. The study was extended to consider all distribution transformers under the same HV feeder and zone substation power transformer, so that end-to-end coordination can be delivered. These are ranked and assessed to be upgraded using the budget allocated.

Application area 2 – Loop impedance / high neutral impedance detection and study

Supply quality data and voltage events are used for the ICP connection high loop impedance study. The WEL approach considers both voltage patterns and calculated impedance patterns to detect potential connection issues, the result is compared against upstream connection levels, e.g. LV circuit and distribution level, in order to narrow down potential fault locations. These patterns are actively monitored and when a defect is detected a fault technician is dispatched to repair this issue. Once complete the results are analysed to confirm the correction of the issue.

Customer feedback - In-house process

If a formal complaint is received, it is investigated, and we endeavour to resolve the problem with the customer. If we receive a complaint, we will:

- Acknowledge the complaint within two working days either in writing or verbally.
- Provide the customer with an update on progress within seven working days if the complaint has not already been resolved.
- Endeavour to resolve the complaint within 20 working days. If not, we provide customers with an explanation in order to extend the investigation by a further 20 working days.
- If the customer complaint is more appropriately dealt with by another party such as an electricity retailer, we may refer the complaint to that company on behalf of the customer. We will notify the customer that we have referred their complaint on and provide the relevant party, name and contact details.

5.3 AMENDMENT Q3

Add ID requirements on practices for connecting new consumers and altering existing connections.

REFERENCE	REQUIREMENT	AMP DOCUMENT REFERENCE
Q3A - Narrative disclosure	Require EDBs to describe their practices for connecting consumers and making alterations to existing connections, including:	
Q3A(i)	The EDB's approach to planning and management regarding connecting new consumers or making alterations to existing connections (offtake and injection connections);	2023 AMP 3.1, 4.1 and 5.3.3
Q3A(ii)	How the EDB is seeking to minimise the cost to consumers of new or altered connections;	2023 AMP 3.1, 4.1, 4.2.1 and 5.3.3
Q3A(iii)	The EDB's approach to planning and managing communication with consumers about new or altered connections;	2023 AMP 3.1 and 5.3.3
Q3A(iv)	Commonly encountered delays, issues, and potential timeframes for different connection types.	2023 AMP 5.3.3

SUMMARY OF OUR APPROACH

Planning and management of new or altered connections

If the connection meets criteria for a point of connection in the road reserve and there is LV supply available, the scope of work is quoted at standard rates in accordance with our Capital Contribution Policy. If the scope of work is deemed to be non-standard, a design is completed and commercially modelled to determine the appropriate customer contribution.

For Distributed Energy Resources (DER) applications, the Asset Strategy and Engineering team participate in the design and approval process. Upon payment, the work is processed through the required activities to delivery.

Our approach to managing communications with customers about new or altered connections is through a portal on the public website called WELConnect. Customers can log into the WELConnect portal and see the status and information on their projects. Additional queries can be communicated by email or phone to staff.

Two Tier One contractors have been bought on board to focus on CIW delivery. The capacity they bring is trending our performance towards our target figures. The current average time to provide a standard quote is 6 days and for non-standard is 32 days. The average time to construct a new ICP or alterations to an existing ICP is 98 days, across all customer work types.

The consumer classes are broken down into the following types:

- Non-standard new connection <110kVA
- Standard new connection <110kVA
- Subdivisions
- Streetlights
- Temporary supplies
- Distributed Generation

Ensuring cost effectiveness

Capital contribution required from the customer is calculated in accordance with WEL's Capital Contribution Policy. The main purpose of the Capital Contribution Policy is to ensure that the option selected is also financially viable. A copy of the policy can be found on WEL's website www.wel.co.nz

Customer Satisfaction (Customer Initiated Works) - Monthly surveys of all customers who have had a new connection or similar customer work-type completed. The survey is conducted by an external research contractor and measures customer satisfaction across Value, Efficiency, Communication, Performance and Outcome. A quarterly report is provided to us for analysis to drive improvements in customer satisfaction. The target is reviewed annually to ensure a customer focus is retained.

The fact that WEL has engaged the two Tier one contractors ensures that work is undertaken in a competitive environment. WEL undertakes an evaluation of similar work undertaken by each contractor to ensure that both are providing cost effectiveness to our customers.

Common delays

Global supply chain shortages in the infrastructure industry have impacted WEL. During the past 2 years, we have seen supply chain constraints affect our ability to deliver on customer expectations as lead times have trebled for some key equipment. Supply chain issues combined to be part of a "perfect storm" as customer spend increased by 27% since 2020, compounded by a tight labour market. This made it challenging to fully meet customer needs. Consequently, we have recently engaged two Tier One contractors to increase capacity. To ensure we fully meet customer requests, we have increased our stock levels to ensure we have frequently used equipment on hand. We have partnered with contractors for delivery to ensure we are responsive to customer requests.

5.4 AMENDMENT Q4

Add ID requirements on customer service, e.g., customer complaints.

REFERENCE	REQUIREMENT	AMP DOCUMENT REFERENCE
Q4 – Narrative disclosure	A requirement for EDBs to describe their current customer service practices including:	
Q4(i)	The EDB's customer engagement protocols and customer service measures – including customer satisfaction with the EDB's supply of electricity distribution services	2023 AMP 5.3.3
Q4(ii)	The EDB's approach to planning and managing customer complaint resolution	2023 AMP 5.3.3

SUMMARY OF OUR APPROACH

Customer service measures

Our customer service performance measures are:

- **Customer satisfaction** – Regular surveys of a sample of customers to gauge their performance expectations, the price they are prepared to pay and their satisfaction with our service.
- **Customer satisfaction (Customer Initiated Works)** - Monthly surveys of all customers who have had a new connection or similar customer work-type completed. The survey is conducted by an external research contractor and measures customer satisfaction across Value, Efficiency, Communication, Performance and Outcome. A quarterly report is provided to us for analysis to drive improvements in customer satisfaction. The target is reviewed annually to ensure a customer focus is retained.
- **Standard new connection quote time** – Measures the average number of working days it takes to provide a quote for upgrades and new connections to our network.
- **Complaint response time** – The average number of working days to provide a resolution to any customer complaint.

Customer feedback - In-house complaints process

We offer a free in-house complaints service. If a formal complaint is received, it is investigated, and we endeavour to resolve the problem with the customer. If we receive a complaint, we will:

- Acknowledge the complaint within two working days either in writing or verbally.
- Provide the customer with an update on progress within seven working days if the complaint has not already been resolved.
- Endeavour to resolve the complaint within 20 working days. If not, we provide customers with an explanation in order to extend the investigation by a further 20 working days.
- If the customer complaint is more appropriately dealt with by another party such as an electricity retailer, we may refer the complaint to that company on behalf of the customer. We will notify the customer that we have referred their complaint on and provide the relevant party, name and contact details.

Customer complaints resolution

Complaints are received by the Customer Services team and reviewed and assigned to the appropriate person to follow to resolution as per our Complaints Management Policy. Customer complaints and compliments are managed by using the WEL customer service portal. If it is because of a third party or natural event out of our control, we refer the customer to their insurance company. If it is a complaint for damage because of WEL activity or equipment failure, we will adopt a fair and reasonable approach on a case-by-case basis. In cases where resolution is not able to be achieved using internal resources, the customer is informed that the Utilities Disputes resolution process is available to them.

5.5 AMENDMENT Q5

Add ID requirements on information about customer charters and guaranteed service level (customer compensation) schemes, e.g., information about existing schemes.

REFERENCE	REQUIREMENT	AMP DOCUMENT REFERENCE
Q5	Require that EDBs publicly disclose up-to-date copies of:	See below
Q5 (i)	The EDB's existing customer charters including guaranteed service levels if any	See below
Q5 (ii)	Information about existing customer compensation schemes (if any) that it has in place	2023 AMP 5.3.3

SUMMARY OF OUR APPROACH

Customer complaints resolution

Complaints are received by the Customer Services team, reviewed, and assigned to the appropriate person to track to resolution, as per our Complaints Management Policy. Customer complaints and compliments are managed using WELConnect. If it is due to a third party or natural event out of our control, we refer the customer to their insurance company. If it is a complaint for damage due to of WEL activity or equipment failure, we adopt a fair and reasonable approach, on a case-by-case basis. In cases where resolution is unable to be achieved through internal resources, the customer is informed that the Utilities Disputes resolution process is available to them.

5.6 AMENDMENT Q13

Refine ID requirements on third party interference interruptions by breaking down into more specific categories, such as vehicle damage, 'dig in', overhead contact, and vandalism.

REFERENCE	REQUIREMENT	AMP DOCUMENT REFERENCE
Q13	Require EDBs to break down reporting of interruptions caused by third-party interference in Schedule 10(ii) to include commonly occurring interruptions resulting from external contractors or members of the public. The new table of additional third-party reporting categories includes:	
Q13(i)	'Dig-In': means any unintended damage to any underground network asset caused by a third party	This will be disclosed in our August 2024 disclosure
Q13(ii)	Overhead Contact: means any form of unintended damage to any above ground network asset caused by contact that is not related to vegetation or animals;	This will be disclosed in our August 2024 disclosure
Q13(iii)	Vandalism: means any intentional destruction of, or damage to, any network asset;	This will be disclosed in our August 2024 disclosure
Q13(iv)	Vehicle Damage: means any unintended damage to any network assets including poles, ground mounted transformers, pillar boxes, but excluding overhead lines, caused by a ground vehicle; and	This will be disclosed in our August 2024 disclosure
Q13(v)	Other	This will be disclosed in our August 2024 disclosure

5.7 AMENDMENT D2

Add requirements on new connections likely to have a significant impact on network operations or asset management priorities.

REFERENCE	REQUIREMENT	AMP DOCUMENT REFERENCE
D2 – Narrative disclosure	Require EDBs to disclose a description of:	
D2(i)	How the EDB measures the scale and impact of new connections;	2023 AMP 6.5
D2(ii)	How the EDB takes the timing and uncertainty of new connections into account;	2023 AMP 6.5 and 6.9.1
D2(iii)	How the EDB takes other factors into account, e.g., the network location of new connection	2023 AMP 6.5
D2(iv)	How the EDB assesses and manages the risk posed by uncertainty regarding new connections	2023 AMP 6.2.4, 6.5 and 6.4.6

SUMMARY OF OUR APPROACH

Uncertainty

Forecasts involve a degree of uncertainty, particularly over longer periods and where there are changing circumstances or the potential for new activities. In the medium-to-long term, emerging technologies, demand, generation, evolving policy, and markets increase the uncertainty of our demand forecasts. Other factors, including short-notice commercial customer applications, result in substantial step changes in demand that are difficult to predict. On the supply and delivery side, there is uncertainty driven by the ongoing impact of the economic uncertainty and global conflicts.

Global macro-economic and policy developments to decarbonise the NZ economy indicate electricity usage and loading on distribution networks will increase. There is less certainty around timing, as users' decisions are critical and less well signalled. WEL is continually scanning the local and global markets, developing data analytics, gauging customer intentions, for trends and triggers for development. Various technology/customer uptake scenarios are created to represent the range of possibilities and the most appropriate ones are selected, reviewed, and regularly updated.

To manage the network of the future and to understand investment requirements a clear understanding of the LV network is critical, and we are investing in LV visibility and management projects. There are limited mechanisms for network control of these new loads, beyond pricing signals. The potential demand flexibility and responsiveness to price of existing and new loads is highly uncertain as distribution pricing signals can be diluted or exacerbated by retail offerings.

The size and timing of our distribution investment is based on net cost-benefit to customers over the lifecycle of customer demand and network assets. Smoothing of network investment ensures that network expansion occurs within finite financial and workforce capacity and overall risks are minimised.

Our development plans and corresponding investments may be amended in subsequent revisions of the AMP reflecting the emerging needs of our customers, stakeholders and changing circumstances on the network. We evolve our planning approach to balance a growing number of priorities.

Demand forecast and contingency scenarios for different areas of the network are input into network models to forecast loading on individual assets and identify constraints that may prevent the system from consistently working to transmit electricity. Potential constraints are:

- Network asset's thermal capacity issues.
- Quality of Supply (or Power Quality).
- Security issues including other reliability concepts such as availability, durability, resilience.
- Legislative and regulatory requirements.
- Safety and environmental requirements.
- The base case includes an economic recession induced slowdown in EV (Electric Vehicle) uptake due to lower disposable income and less favourable financing conditions.

Supplying emergent demand from EV and industrial process electrification requires provisions for demand scenarios. This must be developed before specific timing, location, types of demand and flexibility is firmed up. The provision has been allocated to each region based on current demand and probability of uptake. This will need to be reviewed annually and forecasts adjusted.

5.8 AMENDMENT D4

Add reporting requirements on EDBs' innovation practices

REFERENCE	REQUIREMENT	AMP DOCUMENT REFERENCE
D4 – Narrative requirement	Require EDBs to describe their innovation practices, including a description of:	
D4(i)	Any innovation practices the EDB has planned or undertaken since the last AMP or AMP update was published, including case studies and trials;	2023 AMP 6.6, 6.7 8.2.6 2024 AMP Section 2
D4(ii)	What the desired outcome of any innovation practice is, and how it may improve outcomes for consumers	2023 AMP 6.6.3 2024 AMP Section 2
D4(iii)	How the EDB measures success and makes decisions regarding any innovation practices, e.g. how the EDB decides whether to commence, commercially adopt, or discontinue any innovation practices;	2023 AMP 6.6, 6.7 2024 AMP Section 2
D4(iv)	How the EDB's decision-making about innovation practices may depend on the work of other companies, including other EDBs and providers of nonnetwork solutions; and	2023 AMP 6.6, 6.7 2024 AMP Section 2
D4 (v)	The types of information the EDB uses to inform or enable innovation practices, and their approach to seeking that information.	2023 AMP 6.6, 6.7 2024 AMP Section 2

SUMMARY OF OUR APPROACH

Innovation since last AMP

See section 2 of this document.

Innovation in solution selection

Selection of solutions is based on:

- Whole of lifecycle cost and benefit.
- Cost efficiency of capacity provided or deferred.
- Technical feasibility.
- Availability and reliability.
- Risks mitigated and risks introduced (technical, safety, financial etc.).
- Ease of integration and inter-operability with network and asset management systems.
- Continued long term support.
- Relative economic value of the above factors for alternatives WEL seeks to ensure that local DER (solar/battery) solutions are considered as part of the solution options.

The cost benefit of emergent solutions is evaluated against the same economic and technical criteria as conventional solutions e.g. lifecycle cost per MW and MWh, regardless of form. This is to prevent over investment and passthrough costs of a more expensive solution, or selection of a high-risk endeavour.

We are preparing for emergent solutions to be a pillar of future electricity system security, sustainability, and affordability. Our innovation development path includes improvements to network visibility, and new inter-operability infrastructure and platforms, which will be integrated when they are ready. We continue to trial and test emergent solutions so that optimal economic and technical solutions are deployed for the community.

Flexible open networks

New Zealand's energy future will be shaped by many factors, most of all our customers usage, generation, and management of energy. Electricity distribution networks are the closest interface with the grid for most customers, and where the greatest impact from these changes in customer behaviour will be felt. WEL, as an owner and operator of a distribution network, has a responsibility to evolve our operating model and services to adapt to future operating environments and enable customers' changing use of the network to service their future energy needs.

WEL is developing our operating and service model to support the changes in energy flows, data, flexibility, towards an open access model. An open access network will allow existing and new consumers greater and more equitable utilisation of the distribution network as a vital platform for delivery of energy and capacity to and by consumers.

WEL's investments seek to enable this by developing:

- Standards and processes for greater access to connect and operate any compatible equipment.
- Operational technology to support distribution level DER and flexible demand.

We call this the transition from distribution network owner (DNO) to Distribution System Operator (DSO). We have published our innovation path in the DSO strategy roadmap, shared with industry at the EEA 2022 conference. This strategy outlined how we are going to integrate the traditional network management practice with an innovative DSO service model.

5.9 AMENDMENT AM7A/AM7B

Improve lifecycle asset management planning provisions (vegetation, assumptions).

REFERENCE	REQUIREMENT	AMP DOCUMENT REFERENCE
AM7A	EDBs are required to provide information on vegetation management-related maintenance, and summary discussion of the approach and assumptions that underpin the process used for vegetation management.	2023 AMP 8.2.3
AM7B	EDBs are required to provide the assumptions and rationale used to inform capital expenditure forecasts for asset investments.	2023 AMP 8.1-8.4

SUMMARY OF OUR APPROACH

Vegetation management

Vegetation management is managing vegetation in and around our assets that has the potential to interfere with the safe and reliable supply of electricity to customers and network. WEL has increased the line inspection frequency and has a vegetation management system to record, predict and manage all vegetation works through a mobile solution platform. This system has a purpose-built vegetation growth model based on all New Zealand species, weather, and environment information to aid in proactive targeting of risk areas and future vegetation management requirements. This system has allowed WEL to manage vegetation more effectively.

The current vegetation legislation is under review, and this may lead to a need for vegetation expenditure to change. The current legislation provides minimal ability to address "fall in" trees. Fall in trees are trees that are outside the growth and notice zones specified in the Regulations, however the lines are within the fall radius of the tree. Fall in trees are the predominant contributor to major outages resulting from extreme weather events within the WEL network. Vegetation expenditure is currently based on WEL's vegetation management requirements to maintain safety compliance and ensure network reliability targets are met.

Assumptions and rationale used to inform capital expenditure forecasts

Delivering WEL's performance objectives requires the right balance between expenditure on maintenance and investment in renewals. WEL considers the whole of life cost of the assets and required interventions during their lifecycle, to ensure balance between competing drivers of risk, performance, and costs. As part of capability project initiatives, WEL streamlined its end-to-end asset renewal process to improve the decision making when prioritising replacements and enabling work packaging.

Introducing work scoping at the early stage of the planning process allows efficient grouping of work. An Annual Work List (AWL) is generated, and risk ranked, using the outcomes of the Condition Based Risk Management (CBRM) tool. The CBRM tool uses system data, including condition information to determine the asset health index (AHI) and asset risks, to develop WEL's capital expenditure in this area.

Our asset lifecycle strategy is focused on achieving system reliability and meeting regulatory requirements. The objective contained in our Maintenance Manual is to obtain the most cost-effective method of managing network risk and ensure network assets achieve their expected level of service. We achieve this through Failure Mode Effects and Criticality Analysis (FMECA) and whole of life cycle cost analysis. This is used to develop our individual fleet asset management manuals. These manuals document our approach to maintenance, inspection, renewal, and disposal requirements for each asset class. The information collected in the maintenance and inspection programs is used to inform our Condition-Based Risk Management (CBRM) tool. This tool is used to determine the optimal renewal strategy for each asset class.

For assets, such as HV fuses (DDOs), that do not have a CBRM model, WEL uses information obtained from inspection and reliability tools, such as FMECA to assess the risk of failure and prioritise the renewal programme.

WEL has undertaken analysis on per unit replacement costs. This provides a more detailed understanding of the cost to replace each asset and has been factored into our overall approach.

We have developed an equipment condition feedback loop into our replacement programmes. This requires the teams replacing the assets to provide information on the condition of the assets being removed. That information is then used to calibrate our CBRM model and asset condition grading.

Optimised asset management seeks to lower the cost of replacement for each asset class and considers whole of life costs. WEL lowers these costs through continually reviewing opportunities to improve our approach by optimising scoping, grouping and risk-ranking replacements. This approach has significantly reduced the amount of variation in our annual works programme, resulting in far greater certainty of the works to be delivered in a particular year, with greater clarity of work scope. In FY23 we implemented a mobile platform which incorporated; defect notifications, routine inspections, data corrections and works scoping. Combining these four processes into a single application we can combine tasks which can all be undertaken by a single person, thereby improving efficiency. Additional efficiency driven by this change is the integration directly into SAP removing the need for duplicated data handling, improving both efficiency and the accuracy of data. A full year's worth of asset inspections is now available to our inspectors, giving them greater visibility and flexibility in delivering the annual inspection programme. There are dashboards which provide visibility on progress. Early results show a marked improvement in the delivery of the inspection programme.

We use this grading to ratify our asset replacement programmes, in line with the ISO 55001 requirement for a feedback loop. While WEL is achieving positive results in SAIDI reductions in the equipment failure category, planned SAIDI has been increased to enable the asset replacement programme to be completed.

5.10 AMENDMENT AM8A/AM8B

Improve lifecycle asset management planning provisions (processes, forecast assumptions) and provide additional information on data and models.

REFERENCE	REQUIREMENT	AMP DOCUMENT REFERENCE
AM8A	Amending clause 3.11 of Attachment A to require EDBs to provide a description of:	See below
AM8A(i)	How asset management data informs the models that an EDB develops and uses to assess asset health;	2023 AMP 8.2
AM8A(ii)	How the outputs of these models are used in developing capital expenditure projections.	2023 AMP 8.2 and 8.3
AM8B	That EDBs provide information regarding its consideration of non-network solutions to inform its expenditure projections (capex and opex). This must include an explanation of the approach and assumptions the EDB used to inform these expenditure projections.	2023 AMP 6.6 - 6.7 2024 AMP Section 2

SUMMARY OF OUR APPROACH

The key assumptions and inputs are described below.

Industry standards and analysis tools

Maintenance tasks are determined using industry maintenance standards, supporting tools and analysis that assist maintenance engineers to optimise and rationalise the maintenance plan. In 2021, WEL completed a programme of creating Standard Maintenance Procedure documents (SMPs). SMPs outline the maintenance requirements in the Maintenance Manual, in a more detailed and procedural way. This assists in standardising plant maintenance processes and the capture of key asset information, including asset condition.

Asset inspections

WEL regularly inspects its assets, the surrounding area and vegetation. The inspection or monitoring frequency of an asset is determined by potential risk, manufacturer's recommendations, and legislative requirements. During an asset inspection, the condition is assessed and recorded, along with any defects found, in the Computerised Maintenance Management System. This information is used by the CBRM tool to produce risk profiles and investment scenarios, with options for capital expenditure projections.

Condition assessment

Asset condition influences the extent of servicing, any necessary repairs required and provides vital data to inform asset renewal decisions. The condition assessment is based on a 0 to 5 rating system.

Defect notifications

Defects are identified during inspections and captured into our Enterprise Resource Planning system. If an asset has a defect, the asset inspector will assess the severity of the defect and assign a defect rating.

Capitalised faults

This covers unplanned asset replacement due to network asset failures. The annual quantity of faults is forecast based on historical trends.

Asset renewal

WEL uses CBRM modelling to develop a risk-based approach to planning asset renewals. This approach prioritises the renewal of assets that present the highest risk to safety, network performance, environment, and economic loss. This methodology is used by numerous electricity distribution companies internationally to deliver effective risk-based asset management.

CBRM is a tool that combines asset data and information (e.g. age, asset type, working environment, condition, other factors such as number of connected parties), engineering knowledge as well as practical experience to estimate future condition and performance of network assets.

For assets, such as HV fuses (DDOs), that do not have a CBRM model, WEL uses information obtained from inspection and reliability tools, such as FMECA to assess the risk of failure and prioritise the renewal programme.

Specific risks for each asset category are identified and quantified. WEL has developed CBRM models for all its key asset classes to determine health and risk profiles and used these to develop capital expenditure projections. Through the asset planning process, WEL manages scope and budget requirements of renewal work. This is outlined in the Project Definition Document (PDD). WEL's asset renewal philosophy remains aligned to its previous AMP.

Emergent non-wire (non-network) solutions

Refer section 2 of this document.

Selection of solutions is based on:

- Whole of lifecycle cost and benefit.
- Cost efficiency of capacity provided or deferred.
- Technical feasibility.
- Availability and reliability.
- Risks mitigated and risks introduced (technical, safety, financial etc.).
- Ease of integration and inter-operability with network and asset management systems.
- Continued long term support.
- Relative economic value of the above factors for alternatives WEL seeks to ensure that local DER (solar/battery) solutions are considered as part of the solution options.

The cost benefit of these emergent solutions is considered against the same economic and technical criteria as conventional solutions e.g. lifecycle cost per MW and MWh, regardless of form. This is to prevent over investment and passthrough costs of a more expensive solution, or selection of a high-risk endeavour.

We are preparing for emergent solutions to be a pillar of future electricity system security, sustainability, and affordability. Our innovation development path includes improvements to network visibility, and new inter- operability infrastructure and platforms, which will be integrated when they are ready. We continue to trial and test emergent solutions so that optimal economic and technical solutions are deployed for the community.



CHAPTER 6
DIRECTORS' CERTIFICATE
TE TIWHIKETE RINGATOHU

6 Directors' certificate

Electricity Distribution Information Disclosure Determination 2012 (consolidated July 2023)

Schedule 17 Certification for year-beginning disclosures

Pursuant to clause 2.9.1 of section 2.9

We, Barry Spence Harris and Carolyn Mary Steele being directors of WEL Networks Limited certify that, having made all reasonable enquiry, to the best of our knowledge:

- a) The following attached information of WEL Networks Limited prepared for the purposes of clauses 2.4.1, 2.6.1, 2.6.3, 2.6.6 and 2.7.2 of the Electricity Distribution Information Disclosure Determination 2012 in all material respects complies with that determination.
- b) The prospective financial or non-financial information included in the attached information has been measured on a basis consistent with regulatory requirements or recognised industry standards.
- c) The forecasts in Schedules 11a, 11b, 12a, 12b, 12c and 12d are based on objective and reasonable assumptions which both align with WEL Networks Limited's corporate vision and strategy and are documented in retained records.

Director



Date 5th March 2024

Director



Date 5th March 2024



FREEPHONE 0800 800 935
MAIN OFFICE 07 850 3100
114 MAUI ST, TE RAPA, HAMILTON 3200
PO BOX 925, HAMILTON 3240
WEL.CO.NZ

